



**Technical and Test Institute  
for Construction Prague**  
Prosecká 811/76a  
190 00 Prague  
Czech Republic  
eota@tzus.cz



Member of



www.eota.eu

## European Technical Assessment

**ETA 19/0402  
of 16/05/2022**

(English language translation, the original version in Czech language)

**Technical Assessment Body issuing the ETA:** Technical and Test Institute  
for Construction Prague

**Trade name of the construction product**

Chemofast Injection System VECO  
VECO Tropical  
VECO Express

**Product family to which the  
construction product belongs**

Product area code: 33  
Bonded anchor for use in concrete

**Manufacturer**

Chemofast Anchoring GmbH  
Hanns-Martin-Schleyer-Str. 23  
47877 Willich  
Germany

**Manufacturing plant(s)**

Chemofast Anchoring GmbH

**This European Technical Assessment  
contains**

26 pages including 23 Annexes which form  
an integral part of this assessment.

**This European Technical Assessment is  
issued in accordance with regulation  
(EU) No 305/2011, on the basis of**

EAD 330499-01-0601  
Bonded fasteners for use in concrete

**This version replaces**

ETA 19/0402 issued on 19/07/2019

Translations of this European Technical Assessment in other languages shall fully correspond to the original issued document and should be identified as such.

Communication of this European Technical Assessment, including transmission by electronic means, shall be in full (excepted the confidential Annex(es) referred to above). However, partial reproduction may be made, with the written consent of the issuing Technical Assessment Body - Technical and Test Institute for Construction Prague. Any partial reproduction has to be identified as such.

## 1. Technical description of the product

The Chemofast Injection System VECO, VECO Tropical and VECO Express for cracked and uncracked concrete is a bonded anchor consisting of a cartridge with injection mortar and a steel element. The steel elements consists of a commercial threaded rods with a hexagon nut and a washer or reinforcing bar.

The steel element is placed into a drilled hole filled with injection mortar and is anchored via the bond between metal part, injection mortar and concrete.

The illustration and the description of the product are given in Annex A.

## 2. Specification of the intended use in accordance with the applicable EAD

The performances given in Section 3 are only valid if the anchor is used in compliance with the specifications and conditions given in Annex B.

The provisions made in this European Technical Assessment are based on an assumed working life of the anchor of 50 years. The indications given on the working life cannot be interpreted as a guarantee given by the producer, but are to be regarded only as a means for choosing the products in relation to the expected economically reasonable working life of the works.

## 3. Performance of the product and references to the methods used for its assessment

### 3.1 Mechanical resistance and stability (BWR 1)

Essential characteristic	Performance
Characteristic resistance to tension load (static and quasi-static loading)	Annex C 1, C 2, C 3, C 5
Characteristic resistance to shear load (static and quasi-static loading)	Annex C 1, C 4, C 6
Displacements under short term and long term loading	Annex C 7, C 8
Durability	Annex B 1
Characteristic resistance and displacements for seismic performance categories C1 and C2	Annex C 9, C 10, C 11

### 3.2 Hygiene, health and environment (BWR 3)

No performance determined.

### 3.3 General aspects relating to fitness for use

Durability and serviceability are only ensured if the specifications of intended use according to Annex B1 are kept.

## 4. Assessment and verification of constancy of performance (AVCP) system applied with reference to its legal base

According to the Decision 96/582/EC of the European Commission<sup>1</sup> the system of assessment verification of constancy of performance (see Annex V to Regulation (EU) No 305/2011) given in the following table applies.


Product	Intended use	Level or class	System
Metal anchors for use in concrete	For fixing and/or supporting to concrete, structural elements (which contributes to the stability of the construction works) or heavy units	-	1

<sup>1</sup> Official Journal of the European Communities L 254 of 08.10.1996

**5. Technical details necessary for the implementation of the AVCP system, as provided in the applicable EAD**

The factory production control shall be in accordance with the control plan which is a part of the technical documentation of this European Technical Assessment. The control plan is laid down in the context of the factory production control system operated by the manufacturer and deposited at Technický a zkušební ústav stavební Praha, s.p.<sup>2</sup> The results of factory production control shall be recorded and evaluated in accordance with the provisions of the control plan.

Issued in Prague on 16.05.2022

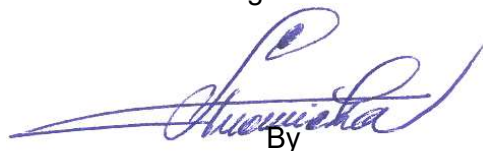

By

**Ing. Jiří Studnička, Ph.D.**  
Head of the Technical Assessment Body




---


<sup>2</sup> The control plan is a confidential part of the documentation of the European Technical Assessment, but not published together with the ETA and only handed over to the approved body involved in the procedure of AVCP.

**Installation threaded rod M8 up to M24**

prepositioned installation or  
push through installation (annular gap filled with mortar)

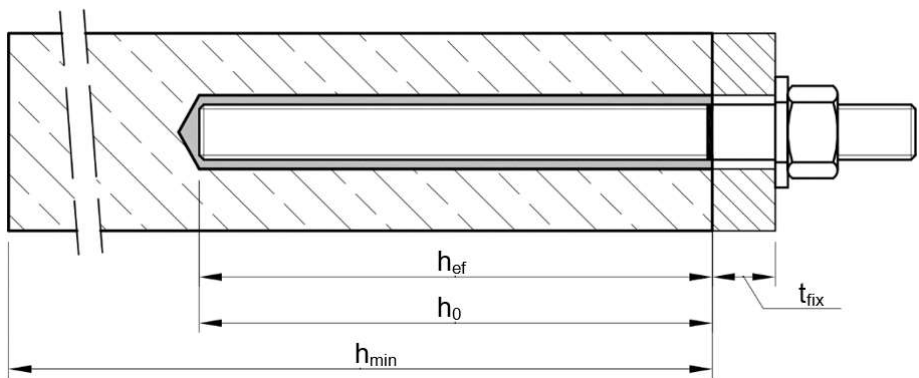

**Installation reinforcing bar Ø8 up to Ø25**

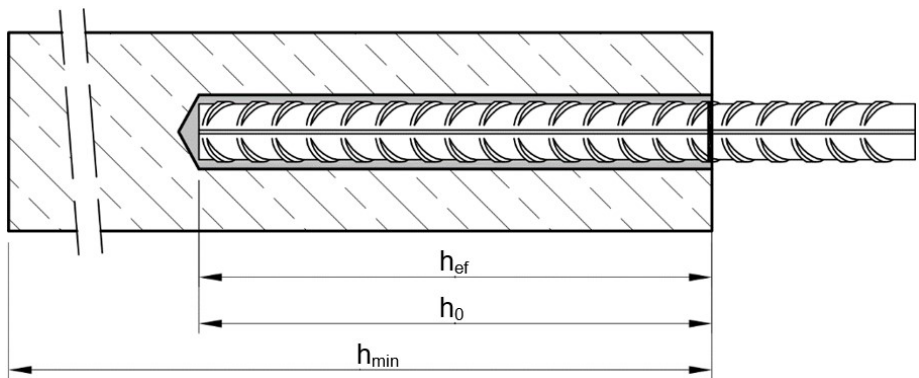

- $t_{fix}$   
 $h_{ef}$   
 $h_{min}$

=

thickness of fixture

=

effective embedment depth

=

minimum thickness of member
- $h_0$

=

depth of drill hole

**Chemofast Injection System VECO, VECO Express, VECO Tropical for concrete**


**Product description**  
Installed conditions

**Annex A 1**

## Cartridge system

### Coaxial Cartridge:

150 ml, 280 ml, 300 ml up to  
333 ml and 380 ml up to 420 ml




#### Imprint:

**VECO, VECO Express or VECO Tropical**

Processing and safety instructions, shelf life, charge number, manufacturer's information, quantity information

### Side-by-Side Cartridge:

235 ml, 345 ml up to 360 ml  
and 825 ml




#### Imprint:

**VECO, VECO Express or VECO Tropical**

Processing and safety instructions, shelf life, charge number, manufacturer's information, quantity information

### Foil Tube Cartridge:

165 ml and 360 ml




#### Imprint:

**VECO, VECO Express or VECO Tropical**

Processing and safety instructions, shelf life, charge number, manufacturer's information, quantity information

## Static mixer SM-14W

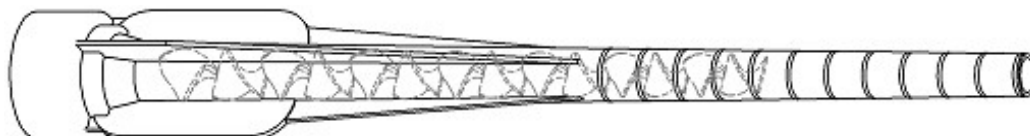


**Chemofast Injection System VECO, VECO Express, VECO Tropical for concrete**

### Product description

Injection system

**Annex A 2**


## Threaded rod M8 up to M24 with washer and hexagon nut

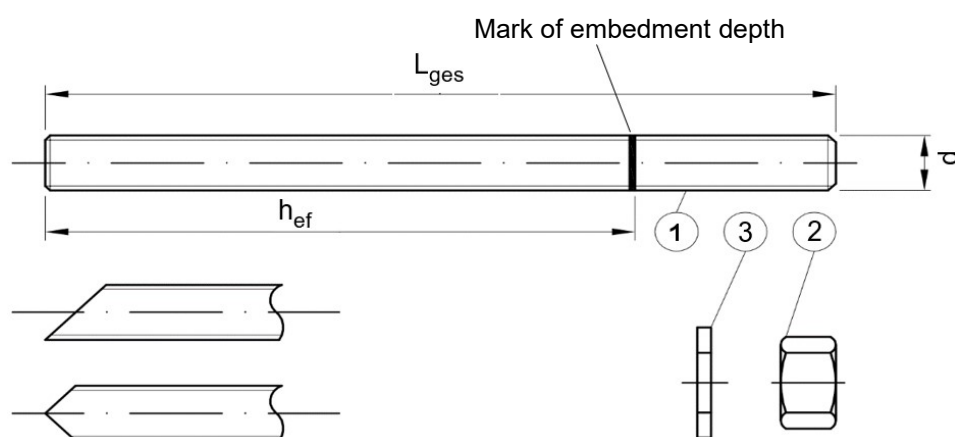

Commercial standard threaded rod with:

- Materials, dimensions and mechanical properties acc. Table A1
- Inspection certificate 3.1 acc. to EN 10204:2004
- Marking of embedment depth

## Filling washer VFS



## Mixer reduction nozzle MR



**Chemofast Injection System VECO, VECO Express, VECO Tropical for concrete**


### Product description

Threaded rod, filling washer and mixer reduction nozzle

**Annex A 3**

Table A1: Materials						
Part	Designation	Material				
<b>Steel, zinc plated</b> (Steel acc. to EN ISO 683-4:2018 or EN 10263:2001)						
<div>- zinc plated ≥ 5 μm acc. to EN ISO 4042:2018 or</div> <div>- hot-dip galvanized ≥ 40 μm acc. to EN ISO 1461:2009 and EN ISO 10684:2004+AC:2009 or</div> <div>- sherardized ≥ 45 μm acc. to EN ISO 17668:2016</div>						
1	Anchor rod	Property class		Characteristic steel ultimate tensile strength	Characteristic steel yield strength	Elongation at fracture
		acc. to EN ISO 898-1:2013	4.6	$f_{uk} = 400 \text{ N/mm}^2$	$f_{yk} = 240 \text{ N/mm}^2$	$A_5 > 8\%$
			4.8	$f_{uk} = 400 \text{ N/mm}^2$	$f_{yk} = 320 \text{ N/mm}^2$	$A_5 > 8\%$
			5.6	$f_{uk} = 500 \text{ N/mm}^2$	$f_{yk} = 300 \text{ N/mm}^2$	$A_5 > 8\%$
			5.8	$f_{uk} = 500 \text{ N/mm}^2$	$f_{yk} = 400 \text{ N/mm}^2$	$A_5 > 8\%$
			8.8	$f_{uk} = 800 \text{ N/mm}^2$	$f_{yk} = 640 \text{ N/mm}^2$	$A_5 > 12\%^{1)}$
2	Hexagon nut	acc. to EN ISO 898-2:2012	4	for anchor rod class 4.6 or 4.8		
			5	for anchor rod class 5.6 or 5.8		
			8	for anchor rod class 8.8		
3a	Washer	Steel, zinc plated, hot-dip galvanized or sherardized (e.g.: EN ISO 887:2006, EN ISO 7089:2000, EN ISO 7093:2000 or EN ISO 7094:2000)				
3b	Filling washer	Steel, zinc plated, hot-dip galvanized or sherardized				
<b>Stainless steel A2</b> (Material 1.4301 / 1.4307 / 1.4311 / 1.4567 or 1.4541, acc. to EN 10088-1:2014)						
<b>Stainless steel A4</b> (Material 1.4401 / 1.4404 / 1.4571 / 1.4362 or 1.4578, acc. to EN 10088-1:2014)						
<b>High corrosion resistance steel</b> (Material 1.4529 or 1.4565, acc. to EN 10088-1: 2014)						
1	Anchor rod <sup>2)</sup>	Property class		Characteristic steel ultimate tensile strength	Characteristic steel yield strength	Elongation at fracture
		acc. to EN ISO 3506-1:2009	50	$f_{uk} = 500 \text{ N/mm}^2$	$f_{yk} = 210 \text{ N/mm}^2$	$A_5 > 8\%$
			70	$f_{uk} = 700 \text{ N/mm}^2$	$f_{yk} = 450 \text{ N/mm}^2$	$A_5 > 12\%^{1)}$
			80	$f_{uk} = 800 \text{ N/mm}^2$	$f_{yk} = 600 \text{ N/mm}^2$	$A_5 > 12\%^{1)}$
2	Hexagon nut <sup>2)</sup>	acc. to EN ISO 3506-1:2009	50	for anchor rod class 50		
			70	for anchor rod class 70		
			80	for anchor rod class 80		
3a	Washer	A2: Material 1.4301, 1.4311 / 1.4307 / 1.4567 or 1.4541, EN 10088-1:2014 A4: Material 1.4401, 1.4404 / 1.4571 / 1.4362 or 1.4578, EN 10088-1:2014 HCR: Material 1.4529 or 1.4565, acc. to EN 10088-1: 2014 (e.g.: EN ISO 887:2006, EN ISO 7089:2000, EN ISO 7093:2000 or EN ISO 7094:2000)				
3b	Filling washer	Stainless steel A4, High corrosion resistance steel				
<div><sup>1)</sup> <math>A_5 &gt; 8\%</math> fracture elongation if no use for seismic performance category C2</div> <div><sup>2)</sup> Property class 80 only for stainless steel A4 and high corrosion resistant steel HCR</div>						
Chemofast Injection System VECO, VECO Express, VECO Tropical for concrete						Annex A 4
Product description Materials						

## Reinforcing bar: ø8 up to ø25



- Minimum value of related rib area  $f_{R,min}$  according to EN 1992-1-1:2004+AC:2010
- Rib height of the bar shall be in the range  $0,05 \phi \leq h_{rib} \leq 0,07 \phi$   
(d: nominal diameter of the bar;  $h_{rib}$ : Rib height of the bar)

**Table A2: Materials Reinforcing bar**

Part	Designation	Material
<b>Rebar</b>		
3	Reinforcing steel according to EN 1992-1-1:2004+AC:2018, Annex C	Bars and rebars from ring class B or C $f_{yk}$ and $k$ according to NDP or NCL according to EN 1992-1-1/NA $f_{uk} = f_{tk} = k \cdot f_{yk}$

**Chemofast Injection System VECO, VECO Express, VECO Tropical for concrete**

**Product description**  
Materials reinforcing bar





**Annex A 5**



Specifications of the intended use				
Fasteners subject to (Static and quasi-static loads):				
	Working life 50 years		Working life 100 years	
Base material	uncracked concrete	cracked concrete	uncracked concrete	cracked concrete
HD: Hammer drilling CD: Compressed air drilling	M8 to M24	M8 to M16	No performance assessed	No performance assessed
Temperature Range:	I: -40°C to +40°C <sup>1)</sup> II: -40°C to +80°C <sup>2)</sup>		I: -40°C to +40°C <sup>1)</sup> II: -40°C to +80°C <sup>2)</sup>	
Fasteners subject to (seismic action):				
	Performance Category C1		Performance Category C2	
Base material	uncracked and cracked concrete		uncracked and cracked concrete	
HD: Hammer drilling CD: Compressed air drilling	M8 to M16		M12 to M16	
Temperature Range:	I: -40°C to +40°C <sup>1)</sup> II: -40°C to +80°C <sup>2)</sup>		I: -40°C to +40°C <sup>1)</sup> II: -40°C to +80°C <sup>2)</sup>	
<sup>1)</sup> (max. long-term temperature +24°C and max. short-term temperature +40°C) <sup>2)</sup> (max. long-term temperature +50°C and max. short-term temperature +80°C)				
<b>Base materials:</b>				
<ul style="list-style-type: none"><li>- Compacted reinforced or unreinforced normal weight concrete without fibres according to EN 206:2013 + A1:2016.</li><li>- Strength classes C20/25 to C50/60 according to EN 206:2013 + A1:2016</li></ul>				
<b>Use conditions (Environmental conditions):</b>				
<ul style="list-style-type: none"><li>- Structures subject to dry internal conditions (all materials).</li><li>- For all other conditions according to EN 1993-1-4:2006+A1:2015 corresponding to corrosion resistance class:<ul style="list-style-type: none"><li>• Stainless steel A2 according to Annex A 4, Table A1: CRC II</li><li>• Stainless steel A4 according to Annex A 4, Table A1: CRC III</li><li>• High corrosion resistance steel HCR according to Annex A 4, Table A1: CRC V</li></ul></li></ul>				
<b>Design:</b>				
<ul style="list-style-type: none"><li>- Verifiable calculation notes and drawings are prepared taking account of the loads to be anchored. The position of the fastener is indicated on the design drawings (e. g. position of the fastener relative to reinforcement or to supports, etc.).</li><li>- Fasteners are designed under the responsibility of an engineer experienced in fasteners and concrete work.</li><li>- The fasteners are designed in accordance to EN 1992-4:2018 and Technical Report TR 055, Edition February 2018.</li></ul>				
<b>Installation:</b>				
<ul style="list-style-type: none"><li>- Dry, wet concrete or flooded bore holes (not sea-water).</li><li>- Hole drilling by hammer drill (HD) or compressed air drill mode (CD).</li><li>- Overhead installation allowed.</li><li>- Fastener installation carried out by appropriately qualified personnel and under the supervision of the person responsible for technical matters of the site.</li></ul>				
Chemofast Injection System VECO, VECO Express, VECO Tropical for concrete				Annex B 1
Intended use Specifications				

Table B1: Installation parameters for threaded rod									
Anchor size			M8	M10	M12	M16	M20	M24	
Diameter of element	$d = d_{nom}$ [mm]		8	10	12	16	20	24	
Nominal drill hole diameter	$d_0$ [mm]		10	12	14	18	24	28	
Effective embedment depth	$h_{ef,min}$ [mm]		60	60	70	80	90	96	
	$h_{ef,max}$ [mm]		160	200	240	320	400	480	
Diameter of clearance hole in the fixture	Prepositioned installation $d_f \leq$		[mm]	9	12	14	18	22	26
	Push through installation $d_f$			12	14	16	20	24	30
Maximum torque moment	$\max T_{inst} \leq$ [Nm]		10	20	40	80	120	160	
Minimum thickness of member	$h_{min}$ [mm]		$h_{ef} + 30 \text{ mm} \geq 100 \text{ mm}$			$h_{ef} + 2d_0$			
Minimum spacing	$s_{min}$ [mm]		40	50	60	80	100	120	
Minimum edge distance	$c_{min}$ [mm]		40	50	60	80	100	120	
Table B2: Installation parameters for rebar									
Anchor size			Ø 8	Ø 10	Ø 12	Ø 14	Ø 16	Ø 20	Ø 25
Diameter of element	$d = d_{nom}$ [mm]		8	10	12	14	16	20	25
Nominal drill hole diameter	$d_0$ [mm]		12	14	16	18	20	25	32
Effective embedment depth	$h_{ef,min}$ [mm]		60	60	70	75	80	90	100
	$h_{ef,max}$ [mm]		160	200	240	280	320	400	500
Minimum thickness of member	$h_{min}$ [mm]		$h_{ef} + 30 \text{ mm} \geq 100 \text{ mm}$			$h_{ef} + 2d_0$			
Minimum spacing	$s_{min}$ [mm]		40	50	60	70	80	100	130
Minimum edge distance	$c_{min}$ [mm]		40	50	60	70	80	100	130
Chemofast Injection System VECO, VECO Express, VECO Tropical for concrete								Annex B 2	
Intended use Installation parameters									


**Table B3: Parameter cleaning and installation tools**

					
Threaded rod	Reinforcing bar	$d_0$ Drill bit - Ø HD, HDB, CD	$d_b$ Brush - Ø		$d_{b,min}$ min. Brush - Ø
[mm]	[mm]	[mm]		[mm]	[mm]
M8	-	10	RBT10	12	10,5
M10	8	12	RBT12	14	12,5
M12	10	14	RBT14	16	14,5
-	12	16	RBT16	18	16,5
M16	14	18	RBT18	20	18,5
-	16	20	RBT20	22	20,5
M20	-	24	RBT24	26	24,5
-	20	25	RBT25	27	25,5
M24	-	28	RBT28	30	28,5
-	25	32	RBT32	34	32,5

## Cleaning and installation tools

### Hand pump

(Volume 750 ml,  $h_0 \geq 10 d_{nom}$ ,  $d_0 \leq 20\text{mm}$ )



### Compressed air tool

(min 6 bar)



### Brush RBT



### Brush extension RBL



**Chemofast Injection System VECO, VECO Express, VECO Tropical for concrete**

### Intended use

IParameter anchor and drill sizes, brushes and piston plugs  
Cleaning and Installation tools

**Annex B 3**

**Table B4: Working and curing time VECO**

Temperature in base material			Maximum working time	Minimum curing time
T			$t_{\text{work}}$	$t_{\text{cure}}$
- 5 °C	to	- 1 °C	90 min	6 h
+ 0 °C	to	+ 4 °C	45 min	3 h
+ 5 °C	to	+ 9 °C	25 min	2 h
+ 10 °C	to	+ 14 °C	20 min	100 min
+ 15 °C	to	+ 19 °C	15 min	80 min
+ 20 °C	to	+ 29 °C	6 min	45 min
+ 30 °C	to	+ 34 °C	4 min	25 min
+ 35 °C	to	+ 39 °C	2 min	20 min
Cartridge temperature			+5°C up to +40°C	

**Table B5: Working and curing time VECO Express**

Temperature in base material			Maximum working time	Minimum curing time
T			$t_{\text{work}}$	$t_{\text{cure}}$
- 10 °C	to	- 6 °C	60 min	4 h
- 5 °C	to	- 1 °C	45 min	2 h
+ 0 °C	to	+ 4 °C	25 min	80 min
+ 5 °C	to	+ 9 °C	10 min	45 min
+ 10 °C	to	+ 14 °C	4 min	25 min
+ 15 °C	to	+ 19 °C	3 min	20 min
+ 20 °C	to	+ 29 °C	2 min	15 min
Cartridge temperature			0°C up to +30°C	


**Table B6: Working and curing time VECO Tropical**

Temperature in base material			Maximum working time	Minimum curing time
T			$t_{\text{work}}$	$t_{\text{cure}}$
+ 10 °C	to	+ 14 °C	30 min	5 h
+ 15 °C	to	+ 19 °C	20 min	210 min
+ 20 °C	to	+ 29 °C	15 min	145 min
+ 30 °C	to	+ 34 °C	10 min	80 min
+ 35 °C	to	+ 39 °C	6 min	45 min
+ 40 °C	to	+ 44 °C	4 min	25 min
+45°C			2 min	20 min
Cartridge temperature			+5°C up to +45°C	

**Chemofast Injection System VECO, VECO Express, VECO Tropical for concrete****Intended use**  
Working and curing time**Annex B 4**

## Installation instructions

### Drilling of the bore hole

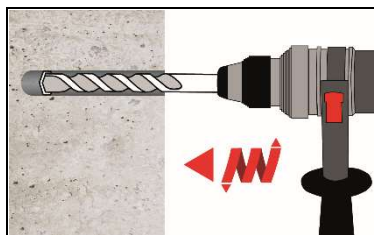


#### 1. Hammer drilling (HD) / Compressed air drilling (CD)


Drill a hole to the required embedment depth.  
Drill bit diameter according to Table B1 and B2.  
Aborted drill holes shall be filled with mortar.  
Proceed with Step 2 (MAC or CAC).

### Manual Air Cleaning (MAC)


for drill hole diameter  $d_0 \leq 20\text{mm}$  and drill hole depth  $h_0 \leq 10d_{\text{nom}}$  with drilling method HD/CD

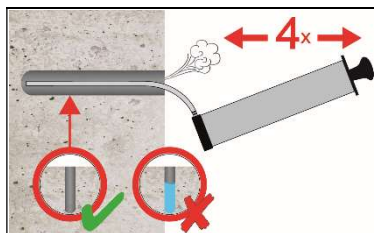

**Attention! Remove standing water in the borehole before cleaning.**  
2a. Blow the bore hole clean minimum 4x from the bottom or back by hand pump (Annex B 3).

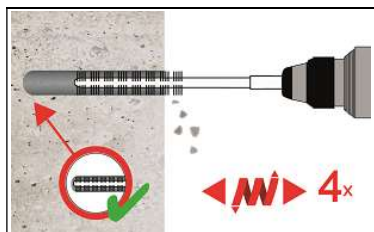


2b. Attach brush RBT according to Table B3 to a drilling machine or a cordless screwdriver. Brush the bore hole minimum 4x over the entire embedment depth in a twisting motion (if necessary, use a brush extension).

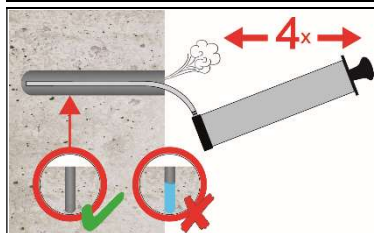

2c. Finally blow the bore hole clean minimum 4x from the bottom or back by hand pump (Annex B 3).


### Compressed Air Cleaning (CAC):

All diameter with drilling method HD/CD

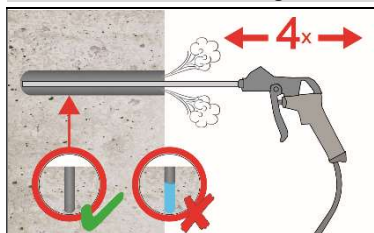

**Attention! Standing water in the bore hole must be removed before cleaning.**

2a. Blow the bore hole clean minimum 4x with compressed air (min. 6 bar) (Annex B 3) over the entire embedment depth until return air stream is free of noticeable dust. (If necessary, an extension shall be used.)

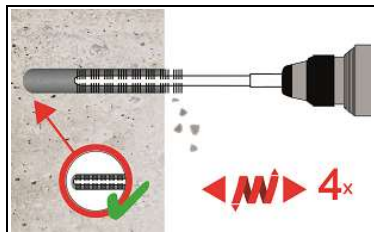


2b. Attach brush RBT according to Table B3 to a drilling machine or a cordless screwdriver. Brush the bore hole minimum 4x over the entire embedment depth in a twisting motion. (If necessary, a brush extension RBL shall be used.)

Chemofast Injection System VECO, VECO Express, VECO Tropical for concrete

Intended use  
Installation instructions

Annex B 5


## Installation instructions (continuation)

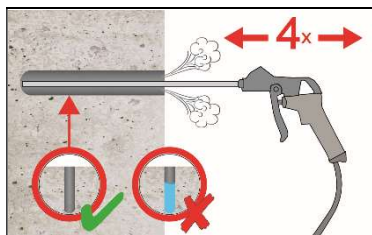


- 2c. Finally blow the bore hole clean minimum 4x with compressed air (min. 6 bar) (Annex B 3) over the entire embedment depth until return air stream is free of noticeable dust. (If necessary, an extension shall be used.)

**Cleaned bore hole has to be protected against re-contamination in an appropriate way.**


**If necessary, repeat cleaning process directly before dispensing the mortar. In-flowing water must not contaminate the bore hole again.**

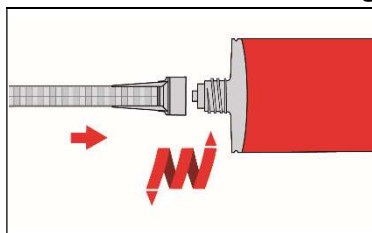


3. Screw on static-mixing nozzle SM-14W and load the cartridge into an appropriate dispensing tool.  
If necessary, cut off the foil tube clip before use.  
For every working interruption longer than the maximum working time  $t_{work}$  (Annex B 4) as well as for new cartridges, a new static-mixer shall be used.

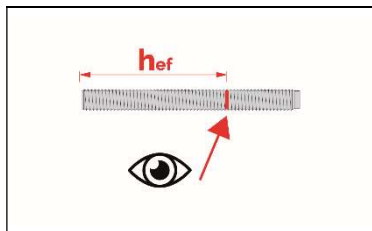


4. Mark embedment depth on the anchor rod.  
The anchor rod shall be free of dirt, grease, oil or other foreign material.

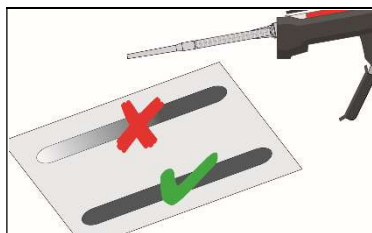

5. Not proper mixed mortar is not sufficient for fastening.  
Dispense and discard mortar until a uniform grey colour is shown (at least 3 full strokes; for foil tube cartridges min. 6 strokes).

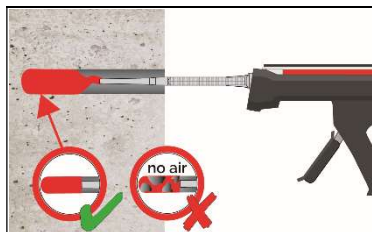

6. Starting at bottom of the hole and fill the hole up to approximately 2/3 with adhesive (If necessary, a mixer nozzle extension shall be used.)  
Slowly withdraw of the static mixing nozzle avoid creating air pockets  
Observe the temperature related working time  $t_{work}$  (Annex B 4).

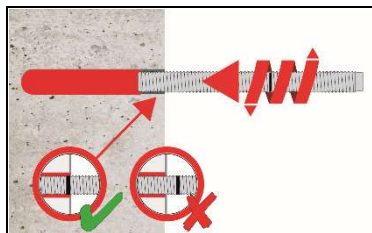


7. Insert the anchor rod while turning slightly up to the embedment mark.

**Chemofast Injection System VECO, VECO Express, VECO Tropical for concrete**


**Intended use**  
Installation instructions (continuation)

**Annex B 6**


## Installation instructions (continuation)

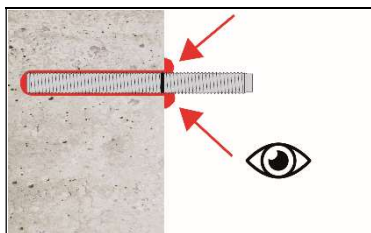

8. Annular gap between anchor rod and base material must be completely filled with mortar. In case of push through installation the annular gap in the fixture must be filled with mortar also. Otherwise, the installation must be repeated starting from step 6 before the maximum working time  $t_{work}$  has expired.

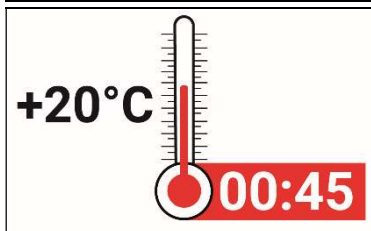

9. Temperature related curing time  $t_{cure}$  (Annex B 4) must be observed. Do not move or load the fastener during curing time.

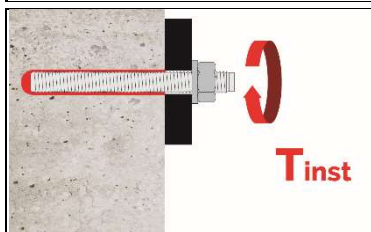

10. Install the fixture by using a calibrated torque wrench. Observe maximum installation torque (Table B1). In case of static requirements (e.g. seismic), fill the annular gap in the fixture with mortar (Annex A 2). Therefore, replace the washer by the filling washer VFS and use the mixer reduction nozzle MR.

Chemofast Injection System VECO, VECO Express, VECO Tropical for concrete

Intended use  
Installation instructions (continuation)

Annex B 7

Table C1: Characteristic values for steel tension resistance and steel shear resistance of threaded rods									
Size				M8	M10	M12	M16	M20	M24
Cross section area		A <sub>s</sub>	[mm <sup>2</sup> ]	36,6	58	84,3	157	245	353
Characteristic tension resistance, Steel failure <sup>1)</sup>									
Steel, Property class 4.6 and 4.8		N <sub>Rk,s</sub>	[kN]	15 (13)	23 (21)	34	63	98	141
Steel, Property class 5.6 and 5.8		N <sub>Rk,s</sub>	[kN]	18 (17)	29 (27)	42	78	122	176
Steel, Property class 8.8		N <sub>Rk,s</sub>	[kN]	29 (27)	46 (43)	67	125	196	282
Stainless steel A2, A4 and HCR, class 50		N <sub>Rk,s</sub>	[kN]	18	29	42	79	123	177
Stainless steel A2, A4 and HCR, class 70		N <sub>Rk,s</sub>	[kN]	26	41	59	110	171	247
Stainless steel A4 and HCR, class 80		N <sub>Rk,s</sub>	[kN]	29	46	67	126	196	282
Characteristic tension resistance, Partial safety factor <sup>2)</sup>									
Steel, Property class 4.6 and 5.6		γ <sub>Ms,N</sub>	[-]	2,0					
Steel, Property class 4.8, 5.8 and 8.8		γ <sub>Ms,N</sub>	[-]	1,5					
Stainless steel A2, A4 and HCR, class 50		γ <sub>Ms,N</sub>	[-]	2,86					
Stainless steel A2, A4 and HCR, class 70		γ <sub>Ms,N</sub>	[-]	1,87					
Stainless steel A4 and HCR, class 80		γ <sub>Ms,N</sub>	[-]	1,6					
Characteristic shear resistance, Steel failure <sup>1)</sup>									
Without lever arm	Steel, Property class 4.6 and 4.8	V <sup>0</sup> <sub>Rk,s</sub>	[kN]	9 (8)	14 (13)	20	38	59	85
	Steel, Property class 5.6 and 5.8	V <sup>0</sup> <sub>Rk,s</sub>	[kN]	9 (8)	15 (13)	21	39	61	88
	Steel, Property class 8.8	V <sup>0</sup> <sub>Rk,s</sub>	[kN]	15 (13)	23 (21)	34	63	98	141
	Stainless steel A2, A4 and HCR, class 50	V <sup>0</sup> <sub>Rk,s</sub>	[kN]	9	15	21	39	61	88
	Stainless steel A2, A4 and HCR, class 70	V <sup>0</sup> <sub>Rk,s</sub>	[kN]	13	20	30	55	86	124
	Stainless steel A4 and HCR, class 80	V <sup>0</sup> <sub>Rk,s</sub>	[kN]	15	23	34	63	98	141
With lever arm	Steel, Property class 4.6 and 4.8	M <sup>0</sup> <sub>Rk,s</sub>	[Nm]	15 (13)	30 (27)	52	133	260	449
	Steel, Property class 5.6 and 5.8	M <sup>0</sup> <sub>Rk,s</sub>	[Nm]	19 (16)	37 (33)	65	166	324	560
	Steel, Property class 8.8	M <sup>0</sup> <sub>Rk,s</sub>	[Nm]	30 (26)	60 (53)	105	266	519	896
	Stainless steel A2, A4 and HCR, class 50	M <sup>0</sup> <sub>Rk,s</sub>	[Nm]	19	37	66	167	325	561
	Stainless steel A2, A4 and HCR, class 70	M <sup>0</sup> <sub>Rk,s</sub>	[Nm]	26	52	92	232	454	784
	Stainless steel A4 and HCR, class 80	M <sup>0</sup> <sub>Rk,s</sub>	[Nm]	30	59	105	266	519	896
Characteristic shear resistance, Partial safety factor <sup>2)</sup>									
Steel, Property class 4.6 and 5.6		γ <sub>Ms,V</sub>	[-]	1,67					
Steel, Property class 4.8, 5.8 and 8.8		γ <sub>Ms,V</sub>	[-]	1,25					
Stainless steel A2, A4 and HCR, class 50 50		γ <sub>Ms,V</sub>	[-]	2,38					
Stainless steel A2, A4 and HCR, class 50 70		γ <sub>Ms,V</sub>	[-]	1,56					
Stainless steel A4 and HCR, class 80		γ <sub>Ms,V</sub>	[-]	1,33					
<sup>1)</sup> Values are only valid for the given stress area A <sub>s</sub> . Values in brackets are valid for undersized threaded rods with smaller stress area A <sub>s</sub> for hot-dip galvanised threaded rods according to EN ISO 10684:2004+AC:2009.									
<sup>2)</sup> In absence of national regulation									
Chemofast Injection System VECO, VECO Express, VECO Tropical for concrete								Annex C 1	
Performances Characteristic values for steel tension resistance and steel shear resistance of threaded rods									



Table C2: Characteristic values of tension loads under static and quasi-static action				
Anchor size			All anchors types and sizes	
Concrete cone failure				
Uncracked concrete	$k_{ucr,N}$	[-]	11,0	
Cracked concrete	$k_{cr,N}$	[-]	7,7	
Edge distance	$c_{cr,N}$	[mm]	$1,5 h_{ef}$	
Axial distance	$s_{cr,N}$	[mm]	$2 c_{cr,N}$	
Splitting				
Edge distance	$h/h_{ef} \geq 2,0$	$c_{cr,sp}$	[mm]	$1,0 h_{ef}$
	$2,0 > h/h_{ef} > 1,3$			$2 \cdot h_{ef} \left( 2,5 - \frac{h}{h_{ef}} \right)$
	$h/h_{ef} \leq 1,3$			$2,4 h_{ef}$
Axial distance	$s_{cr,sp}$	[mm]	$2 c_{cr,sp}$	

Table C3: Characteristic values of tension loads under static and quasi-static action											
Anchor size threaded rod				M8	M10	M12	M16	M20	M24		
Steel failure											
Characteristic tension resistance		$N_{Rk,s}$	[kN]	$A_s \cdot f_{uk}$ (or see Table C1)							
Partial factor		$\gamma_{Ms,N}$	[-]	See Table C1							
Combined pull-out and concrete failure											
Characteristic bond resistance in uncracked concrete C20/25											
Temperature range	I: 40°C/24°C	Dry and wet concrete	$\tau_{Rk,ucr}$	[N/mm²]	8,5	8,0	8,0	8,0	8,0	8,0	
	II: 80°C/50°C				6,5	6,0	6,0	6,0	6,0	6,0	
	I: 40°C/24°C	Flooded bore hole			8,5	8,0	8,0	8,0	8,0	8,0	8,0
	II: 80°C/50°C				6,5	6,0	6,0	6,0	6,0	6,0	
Characteristic bond resistance in cracked concrete C20/25											
Temperature range	I: 40°C/24°C	Dry and wet concrete	$\tau_{Rk,cr}$	[N/mm²]	4,5	4,5	4,5	4,5	No performance assessed		
	II: 80°C/50°C				3,5	3,5	3,5	3,5			
	I: 40°C/24°C	Flooded bore hole			4,5	4,5	4,5	4,5			
	II: 80°C/50°C				3,5	3,5	3,5	3,5			
Increasing factor for uncracked concrete		$\psi_c$	[-]	$(f_{ck} / 20)^{0,2}$							
Increasing factor for cracked concrete		$\psi_c$	[-]	$(f_{ck} / 20)^{0,1}$							
Characteristic bond resistance depending on the concrete strength class		$\tau_{Rk,ucr} =$		$\psi_c \cdot \tau_{Rk,ucr,(C20/25)}$							
		$\tau_{Rk,cr} =$		$\psi_c \cdot \tau_{Rk,cr,(C20/25)}$							
Concrete cone failure											
Relevant parameter				See Table C2							
Splitting											
Relevant parameter				See Table C2							
Installation factor											
Dry and wet concrete		$\gamma_{inst}$	[-]	1,2							
Flooded bore hole				1,2							

**Table C4: Characteristic values of shear loads under static and quasi-static action**

Anchor size threaded rod			M8	M10	M12	M16	M20	M24
<b>Steel failure without lever arm</b>								
Characteristic shear resistance Steel, strength class 4.6, 4.8 and 5.6, 5.8	$V_{Rk,s}^0$	[kN]	$0,6 \cdot A_s \cdot f_{uk}$ (or see Table C1)					
Characteristic shear resistance Steel, strength class 8.8 Stainless Steel A2, A4 and HCR, all strength classes	$V_{Rk,s}^0$	[kN]	$0,5 \cdot A_s \cdot f_{uk}$ (or see Table C1)					
Partial factor	$\gamma_{Ms,V}$	[-]	See Table C1					
Ductility factor	$k_7$	[-]	1,0					
<b>Steel failure with lever arm</b>								
Characteristic bending moment	$M_{Rk,s}^0$	[Nm]	$1,2 \cdot W_{el} \cdot f_{uk}$ (or see Table C1)					
Elastic section modulus	$W_{el}$	[mm <sup>3</sup> ]	31	62	109	277	541	935
Partial factor	$\gamma_{Ms,V}$	[-]	See Table C1					
<b>Concrete pry-out failure</b>								
Factor	$k_8$	[-]	2,0					
Installation factor	$\gamma_{inst}$	[-]	1,0					
<b>Concrete edge failure</b>								
Effective length of fastener	$l_f$	[mm]	$\min(h_{ef}, 12 \cdot d_{nom})$					
Outside diameter of fastener	$d_{nom}$	[mm]	8	10	12	16	20	24
Installation factor	$\gamma_{inst}$	[-]	1,0					
<b>Chemofast Injection System VECO, VECO Express, VECO Tropical for concrete</b>							<b>Annex C 4</b>	
<b>Performances</b> Characteristic values of shear loads under static and quasi-static action								

Table C5: Characteristic values of tension loads under static and quasi-static action											
Anchor size reinforcing bar				Ø 8	Ø 10	Ø 12	Ø 14	Ø 16	Ø 20	Ø 25	
Steel failure											
Characteristic tension resistance		N <sub>Rk,s</sub>	[kN]	A <sub>s</sub> · f <sub>uk</sub> <sup>1)</sup>							
Cross section area		A <sub>s</sub>	[mm²]	50	79	113	154	201	314	491	
Partial factor		γ <sub>Ms,N</sub>	[-]	1,4 <sup>2)</sup>							
Combined pull-out and concrete failure											
Characteristic bond resistance in uncracked concrete C20/25											
Temperature range	I: 40°C/24°C	Dry and wet concrete	τ <sub>Rk,ucr</sub>	[N/mm²]	7,0	7,0	7,0	7,0	6,5	6,5	6,5
	II: 80°C/50°C				5,5	5,5	5,5	5,5	5,5	5,0	5,0
	I: 40°C/24°C	Flooded bore hole			7,0	7,0	7,0	7,0	6,5	6,5	6,5
	II: 80°C/50°C				5,5	5,5	5,5	5,5	5,5	5,0	5,0
Increasing factor for uncracked concrete		ψ <sub>c</sub>	[-]	(f <sub>ck</sub> / 20) <sup>0,1</sup>							
Characteristic bond resistance depending on the concrete strength class		τ <sub>Rk,ucr</sub> =		ψ <sub>c</sub> · τ <sub>Rk,ucr,(C20/25)</sub>							
Concrete cone failure											
Relevant parameter				See Table C2							
Splitting											
Relevant parameter				See Table C2							
Installation factor											
Dry and wet concrete		γ <sub>inst</sub>	[-]	1,2							
Flooded bore hole				1,2							
<div><div><sup>1)</sup> f<sub>uk</sub> shall be taken from the specifications of reinforcing bars</div><div><sup>2)</sup> in absence of national regulation</div></div>											
Chemofast Injection System VECO, VECO Express, VECO Tropical for concrete									Annex C 5		
Performances Characteristic values of tension loads under static and quasi-static action											

Table C6: Characteristic values of shear loads under static and quasi-static action										
Anchor size reinforcing bar			Ø 8	Ø 10	Ø 12	Ø 14	Ø 16	Ø 20	Ø 25	
Steel failure without lever arm										
Characteristic shear resistance	$V_{RK,s}^0$	[kN]	$0,50 \cdot A_s \cdot f_{uk}^{1)}$							
Cross section area	$A_s$	[mm²]	50	79	113	154	201	314	491	
Partial factor	$\gamma_{Ms,V}$	[-]	$1,5^{2)}$							
Ductility factor	$k_7$	[-]	1,0							
Steel failure with lever arm										
Characteristic bending moment	$M_{RK,s}^0$	[Nm]	$1,2 \cdot W_{el} \cdot f_{uk}^{1)}$							
Elastic section modulus	$W_{el}$	[mm³]	50	98	170	269	402	785	1534	
Partial factor	$\gamma_{Ms,V}$	[-]	$1,5^{2)}$							
Concrete pry-out failure										
Factor	$k_8$	[-]	2,0							
Installation factor	$\gamma_{inst}$	[-]	1,0							
Concrete edge failure										
Effective length of fastener	$l_f$	[mm]	$\min(h_{ef}; 12 \cdot d_{nom})$							$\min(h_{ef}; 300mm)$
Outside diameter of fastener	$d_{nom}$	[mm]	8	10	12	14	16	20	25	
Installation factor	$\gamma_{inst}$	[-]	1,0							
<div><sup>1)</sup> <math>f_{uk}</math> shall be taken from the specifications of reinforcing bars</div> <div><sup>2)</sup> in absence of national regulation</div>										
Chemofast Injection System VECO, VECO Express, VECO Tropical for concrete								Annex C 6		
Performances Characteristic values of shear loads under static and quasi-static action										

Table C7: Displacement under tension load <sup>1)</sup>								
Anchor size threaded rod			M8	M10	M12	M16	M20	M24
Uncracked concrete C20/25 under static and quasi-static action								
Temperature range I: 40°C/24°C	δ <sub>N0</sub> -factor	[mm/(N/mm²)]	0,03	0,04	0,05	0,07	0,08	0,10
	δ <sub>N∞</sub> -factor	[mm/(N/mm²)]	0,07	0,08	0,08	0,08	0,08	0,10
Temperature range II: 80°C/50°C	δ <sub>N0</sub> -factor	[mm/(N/mm²)]	0,02	0,03	0,03	0,04	0,04	0,05
	δ <sub>N∞</sub> -factor	[mm/(N/mm²)]	0,15	0,17	0,17	0,17	0,17	0,17
Cracked concrete C20/25 under static and quasi-static action								
Temperature range I: 40°C/24°C	δ <sub>N0</sub> -factor	[mm/(N/mm²)]	0,07	0,08	0,07	0,08	No performance assessed	
	δ <sub>N∞</sub> -factor	[mm/(N/mm²)]	0,13	0,11	0,11	0,10		
Temperature range II: 80°C/50°C	δ <sub>N0</sub> -factor	[mm/(N/mm²)]	0,09	0,08	0,07	0,09		
	δ <sub>N∞</sub> -factor	[mm/(N/mm²)]	0,17	0,14	0,14	0,13		
1) Calculation of the displacement δ <sub>N0</sub> = δ <sub>N0</sub> -factor · τ;								

Table C9: Displacement under tension load <sup>1)</sup>									
Anchor size reinforcing bar			Ø 8	Ø 10	Ø 12	Ø 14	Ø 16	Ø 20	Ø 25
Uncracked concrete C20/25 under static and quasi-static action									
Temperature range I: 40°C/24°C	δ <sub>N0</sub> -factor	[mm/(N/mm²)]	0,03	0,06	0,02	0,03	0,05	0,06	0,06
	δ <sub>N∞</sub> -factor	[mm/(N/mm²)]	0,08	0,08	0,08	0,08	0,08	0,08	0,08
Temperature range II: 80°C/50°C	δ <sub>N0</sub> -factor	[mm/(N/mm²)]	0,03	0,06	0,02	0,03	0,05	0,06	0,06
	δ <sub>N∞</sub> -factor	[mm/(N/mm²)]	0,15	0,15	0,15	0,15	0,16	0,16	0,16
1) Calculation of the displacement δ <sub>N0</sub> = δ <sub>N0</sub> -factor · τ;                      τ: action bond stress for tension δ <sub>N∞</sub> = δ <sub>N∞</sub> -factor · τ;									
Table C10: Displacement under shear load <sup>1)</sup>									
Anchor size reinforcing bar			Ø 8	Ø 10	Ø 12	Ø 14	Ø 16	Ø 20	Ø 25
Uncracked concrete C20/25 under static and quasi-static action									
All temperature ranges	δ <sub>V0</sub> -factor	[mm/kN]	0,04	0,04	0,01	0,01	0,01	0,01	0,01
	δ <sub>V∞</sub> -factor	[mm/kN]	0,05	0,06	0,02	0,02	0,02	0,02	0,02
1) Calculation of the displacement δ <sub>V0</sub> = δ <sub>V0</sub> -factor · V;                      V: action shear load δ <sub>V∞</sub> = δ <sub>V∞</sub> -factor · V;									
Chemofast Injection System VECO, VECO Express, VECO Tropical for concrete								Annex C 8	
Performances Displacements under static and quasi-static action									

Table C11: Characteristic values of tension loads under seismic action (Performance category C1)								
Anchor size threaded rod				M8	M10	M12	M16	
Steel failure								
Characteristic tension resistance			$N_{Rk,s,C1}$	[kN]	$1,0 \cdot N_{Rk,s}$			
Partial factor			$\gamma_{Ms,N}$	[-]	See Table C1			
Combined pull-out and concrete failure								
Characteristic bond resistance in cracked and uncracked concrete C20/25								
Temperature range	I: 40°C/24°C	Dry and wet concrete	$\tau_{Rk,C1}$	[N/mm²]	2,30	2,25	2,30	2,20
	II: 80°C/50°C				1,85	1,80	1,80	1,75
	I: 40°C/24°C	Flooded bore hole			2,30	2,25	2,30	2,20
	II: 80°C/50°C				1,85	1,80	1,80	1,75
Increasing factor for concrete			$\psi_c$	[-]	1,0			
Characteristic bond resistance depending on the concrete strength class			$\tau_{Rk,C1} =$		$\psi_c \cdot \tau_{Rk,C1,(C20/25)}$			
Installation factor								
Dry and wet concrete			$\gamma_{inst}$	[-]	1,2			
Flooded bore hole					1,2			
Table C12: Characteristic values of tension loads under seismic action (Performance category C2)								
Anchor size threaded rod				M12		M16		
Steel failure								
Characteristic tension resistance			$N_{Rk,s,C2}$	[kN]	$1,0 \cdot N_{Rk,s}$			
Steel, strength class 8.8 Stainless Steel A4 and HCR, Strength class $\geq 70$								
Partial factor			$\gamma_{Ms,N}$	[-]	See Table C1			
Combined pull-out and concrete failure								
Characteristic bond resistance in cracked and uncracked concrete C20/25								
Temperature range	I: 40°C/24°C	Dry and wet concrete	$\tau_{Rk,C2}$	[N/mm²]	0,75		0,95	
	II: 80°C/50°C				0,60		0,75	
	I: 40°C/24°C	Flooded bore hole			0,75		0,95	
	II: 80°C/50°C				0,60		0,75	
Increasing factor for concrete			$\psi_c$	[-]	1,0			
Characteristic bond resistance depending on the concrete strength class			$\tau_{Rk,C2} =$		$\psi_c \cdot \tau_{Rk,C2,(C20/25)}$			
Installation factor								
Dry and wet concrete			$\gamma_{inst}$	[-]	1,2			
Flooded bore hole					1,2			
Chemofast Injection System VECO, VECO Express, VECO Tropical for concrete							Annex C 9	
Performances								
Characteristic values of tension loads under seismic action (Performance category C1 and C2)								



Table C13: Characteristic values of shear loads under seismic action (Performance category C1 and C2)					
Anchor size threaded rod		M8	M10	M12	M16
Steel failure without lever arm					
Characteristic shear resistance (Seismic C1)	$V_{Rk,s,C1}$	[kN]	0,7 · $V^0_{Rk,s}$		
Characteristic shear resistance (Seismic C2) Steel, strength class 8.8 Stainless Steel A2, A4 and HCR, Strength class ≥70	$V_{Rk,s,C2}$	[kN]	No performance assessed	0,7 · $V^0_{Rk,s}$	
Partial factor	$\gamma_{Ms,V}$	[-]	See Table C1		
Factor for annular gap	$\alpha_{gap}$	[-]	0,5 (1,0) <sup>1)</sup>		
1) Value in brackets valid for filled annular gap between anchor and clearance hole in the fixture. Use of special filling washer Annex A 3 is recommended					

Table C14: Displacement under tension load						
Anchor size threaded rod			M8	M10	M12	M16
Uncracked and cracked concrete under seismic action (performance category C2)						
Temperature range I: 40°C/24°C	$\delta_{N,C2(DLS)}$	[mm]	No performance assessed	0,23	0,29	
	$\delta_{N,C2(ULS)}$	[mm]		0,43	0,55	
Temperature range II: 80°C/50°C	$\delta_{N,C2(DLS)}$	[mm]		0,23	0,29	
	$\delta_{N,C2(ULS)}$	[mm]		0,43	0,55	
Table C15: Displacement under shear load						
Anchor size threaded rod			M8	M10	M12	M16
Uncracked and cracked concrete under seismic action (performance category C2)						
Temperature range I: 40°C/24°C	$\delta_{V,C2(DLS)}$	[mm]	No performance assessed	3,6	3,0	
	$\delta_{V,C2(ULS)}$	[mm]		7,0	6,6	
Temperature range II: 80°C/50°C	$\delta_{V,C2(DLS)}$	[mm]		3,6	3,0	
	$\delta_{V,C2(ULS)}$	[mm]		7,0	6,6	