

Approval body for construction products
and types of construction

Bautechnisches Prüfamt

An institution established by the Federal and
Laender Governments



European Technical Assessment

**ETA-15/0514
of 15 September 2021**

English translation prepared by DIBt - Original version in German language

General Part

Technical Assessment Body issuing the
European Technical Assessment:

Trade name of the construction product

Product family
to which the construction product belongs

Manufacturer

Manufacturing plant

This European Technical Assessment
contains

This European Technical Assessment is
issued in accordance with Regulation (EU)
No 305/2011, on the basis of

This version replaces

Deutsches Institut für Bautechnik

TSM high performance, TSM high performance A4,
TSM high performance HCR

Mechanical fasteners for use in concrete

TOGE Dübel GmbH & Co. KG
Illesheimer Straße 10
90431 Nürnberg
DEUTSCHLAND

TOGE Dübel GmbH & Co. KG

22 pages including 3 annexes which form an integral part
of this assessment

EAD 330232-00-0601, Edition 10/2016

ETA-15/0514 issued on 22 September 2020

The European Technical Assessment is issued by the Technical Assessment Body in its official language. Translations of this European Technical Assessment in other languages shall fully correspond to the original issued document and shall be identified as such.

Communication of this European Technical Assessment, including transmission by electronic means, shall be in full. However, partial reproduction may only be made with the written consent of the issuing Technical Assessment Body. Any partial reproduction shall be identified as such.

This European Technical Assessment may be withdrawn by the issuing Technical Assessment Body, in particular pursuant to information by the Commission in accordance with Article 25(3) of Regulation (EU) No 305/2011.

Specific Part

1 Technical description of the product

The TOGE Concrete screw TSM high performance is an anchor in size 6, 8, 10, 12 and 14 mm made of galvanised steel respectively steel with zinc flake coating, made of stainless or high corrosion resistant steel. The anchor is screwed into a predrilled cylindrical drill hole. The special thread of the anchor cuts an internal thread into the member while setting. The anchorage is characterised by mechanical interlock in the special thread.

Product and product description are given in Annex A.

2 Specification of the intended use in accordance with the applicable European Assessment Document

The performances given in Section 3 are only valid if the anchor is used in compliance with the specifications and conditions given in Annex B.

The verifications and assessment methods on which this European Technical Assessment is based lead to the assumption of a working life of the anchor of at least 50 years. The indications given on the working life cannot be interpreted as a guarantee given by the producer, but are to be regarded only as a means for choosing the right products in relation to the expected economically reasonable working life of the works.

3 Performance of the product and references to the methods used for its assessment

3.1 Mechanical resistance and stability (BWR 1)

Essential characteristic	Performance
Characteristic resistance to tension load (static and quasi-static loading)	See Annex C 1 and C 2
Characteristic resistance to shear load (static and quasi-static loading)	See Annex C 1 and C 2
Displacements (static and quasi-static loading)	See Annex C 7
Characteristic resistance and displacements for seismic performance categories C1 and C2	See Annex C 3, C 4, C 5 and C 8
Durability	See Annex B 1

3.2 Safety in case of fire (BWR 2)

Essential characteristic	Performance
Reaction to fire	Class A1
Resistance to fire	See Annex C 6

European Technical Assessment

ETA-15/0514

English translation prepared by DIBt

Page 4 of 22 | 15 September 2021

4 Assessment and verification of constancy of performance (AVCP) system applied, with reference to its legal base

In accordance with European Assessment Document EAD No. 330232-00-0601 the applicable European legal act is: [96/582/EC].

The system to be applied is: 1

5 Technical details necessary for the implementation of the AVCP system, as provided for in the applicable European Assessment Document

Technical details necessary for the implementation of the AVCP system are laid down in the control plan deposited at Deutsches Institut für Bautechnik.

Issued in Berlin on 15 September 2021 by Deutsches Institut für Bautechnik


Dipl.-Ing. Beatrix Wittstock
Head of Section

beglaubigt:
Tempel


Product in installed condition

TOGE concrete screw TSM high performance


- Galvanized carbon steel
- Zinc flakes coated carbon steel

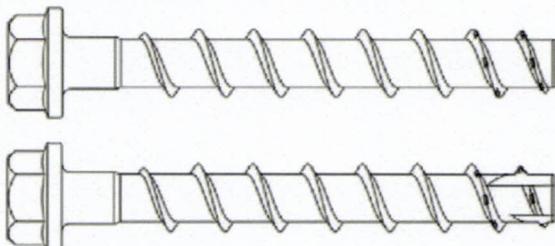

- Stainless steel A4
- Stainless steel HCR



e.g. TOGE concrete screw, zinc flakes coated, with hexagon head and fixture

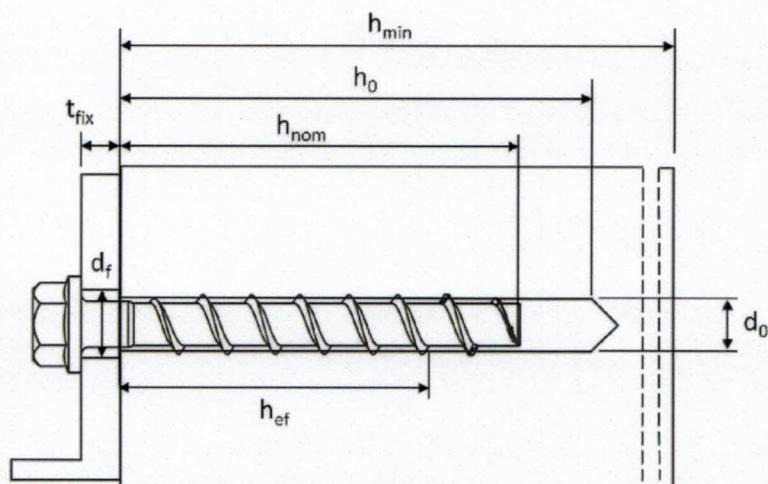

d_0 = nominal drill hole diameter

t_{fix} = thickness of fixture

d_f = clearance hole diameter




h_{min} = minimum thickness of member

h_{nom} = nominal embedment depth

h_0 = drill hole depth

h_{ef} = effective embedment depth

Filling washer (optional)
to fill annular gap

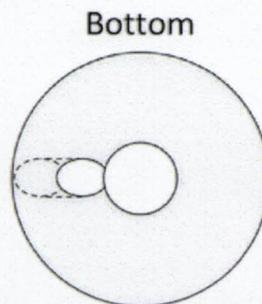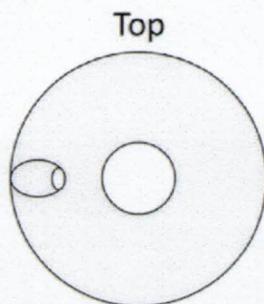


TOGE concrete screw TSM high performance

Product description

Product in installed condition

Annex A1

		Configuration with metric connection threat and hexagon socket e.g. TSM 8x105 M10 SW5; Type ST
		Configuration with metric connection threat and hexagon drive e.g. TSM 8x105 M10 SW7; Type ST
		Configuration with washer and hexagon head e.g. TSM 8x80 SW13 VZ 40; Type S
		Configuration with washer, hexagon head and TORX drive e.g. TSM 8x80 SW13; Type S
		Configuration with washer and bund e.g. TSM BC ST 14x130 SW24 VZ 40; Type BND
		Configuration with hexagon head e.g. TSM 8x80 SW13 OS; Type S
		Configuration with countersunk head and TORX drive e.g. TSM 8x80 C VZ 40; Type SK
		Configuration with pan head and TORX drive e.g. TSM 8x80 P VZ 40; Type P
		Configuration with large pan head and TORX drive e.g. TSM 8x80 LP VZ 40; Type P
		Configuration with countersunk head and connection thread e.g. TSM 6x55 AG M8; Type ST-6
		Configuration with hexagon drive and connection thread e.g. TSM 6x55 M8 SW10; Type ST-6
		Configuration with internal thread and hexagon drive e.g. TSM 6x55 IM M8/10; Type I

TOGE concrete screw TSM high performance

Product description
Screw types

Annex A2

Table 1: Material

Part	Product name	Material		
all types	TSM high performance	<ul style="list-style-type: none"> - Steel EN 10263-4:2017 galvanized acc. to EN ISO 4042:2018 - Zinc flake coating according to EN ISO 10683:2018 ($\geq 5\mu\text{m}$) - Zinc flake coating according to EN ISO 10683:2018 special coating TOGE KORR ($\geq 20\mu\text{m}$) 		
	TSM high performance A4	1.4401; 1.4404; 1.4571; 1.4578		
	TSM high performance HCR	1.4529		
Part	Product name	Nominal characteristic steel Yield strength $f_{yk} [\text{N/mm}^2]$	Ultimate strength $f_{uk} [\text{N/mm}^2]$	Rupture elongation $A_s [\%]$
all types	TSM high performance	560	700	≤ 8
	TSM high performance A4			
	TSM high performance HCR			

Table 2: Dimensions

Anchor size		6	8		10			12			14		
Nominal embedment depth	h_{nom}	1	2	1	2	3	1	2	3	1	2	3	1
	[mm]	40	55	45	55	65	55	75	85	65	85	100	75
Screw length	$\leq L$	[mm] 500											
Core diameter	d_k	[mm] 5,1		7,1		9,1		11,1		13,1			
Thread outer diameter	d_s	[mm] 7,5		10,6		12,6		14,6		16,6			
Thickness of filling washer	t_v	[mm] -		5		5		5		5			

Marking:

TSM high performance

Screw type: TSM
Screw size: 10
Screw length: 100



TSM high performance BC ST

Screw type: TSM BC ST
Screw size: 10
Screw length: 100




TSM high performance A4

Screw type: TSM
Screw size: 10
Screw length: 100
Material: A4



TSM high performance HCR

Screw type: TSM
Screw size: 10
Screw length: 100
Material: HCR

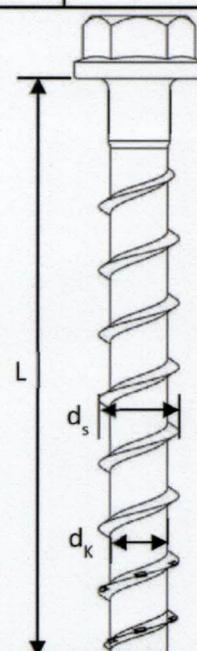

TOGE concrete screw TSM high Performance

Product description
Material, Dimensions and markings

Annex A3

Specification of Intended use

Table 3: Anchorages subject to

TSM concrete screw size		6		8			10			12			14			
Nominal embedment depth	[mm]	h_{nom1}	h_{nom2}	h_{nom1}	h_{nom2}	h_{nom3}										
		40	55	45	55	65	55	75	85	65	85	100	65	85	115	
Static and quasi-static loads		All sizes and all embedment depths														
Fire exposure																
C1 category - seismic		ok	ok	1)	ok	ok	1)									
C2 category – seismic (A4 and HCR: no performance assessed)		1)														

1) no performance assessed

Base materials:

- Compacted reinforced and unreinforced concrete without fibers according to EN 206:2013.
- Strength classes C20/25 to C50/60 according to EN 206:2013.
- Cracked and uncracked concrete.

Use conditions (Environmental conditions):

- Concrete screws subject to dry internal conditions: all screw types.
- Structural subject to external atmospheric exposure (including industrial and marine environment) and to permanently damp internal condition no particular aggressive conditions exists: screw types made of stainless steel with marking A4.
- Structural subject to external atmospheric exposure (including industrial and marine environment) and to permanently damp internal condition if particular aggressive conditions exists: screw types made of stainless steel with marking HCR.

Note: Such particular aggressive conditions are e.g. permanent, alternating immersion in seawater or splash zone of seawater, chloride atmosphere of indoor swimming pools or atmosphere with chemical pollution (e.g. in desulphurization plants or road tunnels where de-icing materials are used).

TOGE concrete screw TSM high Performance

Intended use
Specification

Annex B1

Specification of Intended use - continuation

Design:

- Anchorages are to be designed under the responsibility of an engineer experienced in anchorages and concrete work.
- Verifiable calculation notes and drawings are to be prepared taking account of the loads to be anchored. The position of the anchor is indicated on the design drawings (e.g. position of the anchor relative to reinforcement or to supports, etc.).
- Anchorages are designed according to EN 1992-4:2018 and EOTA Technical Report TR 055.
The design for shear load according to EN 1992-4:2018, Section 6.2.2 applies for all specified diameters d_f of clearance hole in the fixture in Annex B3, Table 4.

Installation:

- Hammer drilling or hollow drilling.
- Anchor installation carried out by appropriately qualified personnel and under the supervision of the person responsible for technical matters on site.
- In case of aborted hole: new drilling must be drilled at a minimum distance of twice the depth of aborted hole or closer, if the aborted hole is filled with high strength mortar and only if the hole is not in the direction of the oblique tensile or shear load.
- After installation further turning of the anchor must not be possible. The head of the anchor is supported in the fixture and is not damaged.
- The borehole may be filled with injection mortar CF-T 300V or ATA 2004C.
- Adjustability according to Annex B6 for sizes 6-14, all embedment depths except for applications with filled borehole and not for seismic applications.
- Cleaning of borehole is not necessary, if using a hollow drill.


TOGE concrete screw TSM high Performance

Intended use
Specification continuation

Annex B2

Table 4: Installation parameters

TSM concrete screw size		6		8			10		
Nominal embedment depth	h_{nom}	$h_{\text{nom}1}$	$h_{\text{nom}2}$	$h_{\text{nom}1}$	$h_{\text{nom}2}$	$h_{\text{nom}3}$	$h_{\text{nom}1}$	$h_{\text{nom}2}$	$h_{\text{nom}3}$
	[mm]	40	55	45	55	65	55	75	85
Nominal drill hole diameter	d_0	[mm]	6		8			10	
Cutting diameter of drill bit	$d_{\text{cut}} \leq$	[mm]	6,40		8,45			10,45	
Drill hole depth	$h_0 \geq$	[mm]	45	60	55	65	75	65	85
Clearance hole diameter	$d_f \leq$	[mm]	8		12			14	
Installation torque (version with connection thread)	T_{inst}	[Nm]	10		20			40	
Torque impact screw driver	[Nm]	Max. torque according to manufacturer's instructions							
		160	300			400			
TSM concrete screw size		12				14			
Nominal embedment depth	h_{nom}	$h_{\text{nom}1}$	$h_{\text{nom}2}$	$h_{\text{nom}3}$		$h_{\text{nom}1}$	$h_{\text{nom}2}$	$h_{\text{nom}3}$	
	[mm]	65	85	100		75	100	115	
Nominal drill hole diameter	d_0	[mm]	12			14			
Cutting diameter of drill bit	$d_{\text{cut}} \leq$	[mm]	12,50			14,50			
Drill hole depth	$h_0 \geq$	[mm]	75	95	110	85	110	125	
Clearance hole diameter	$d_f \leq$	[mm]	16			18			
Installation torque (version with connection thread)	T_{inst}	[Nm]	60			80			
Torque impact screw driver	[Nm]	Max. torque according to manufacturer's instructions							
		650	650			650			

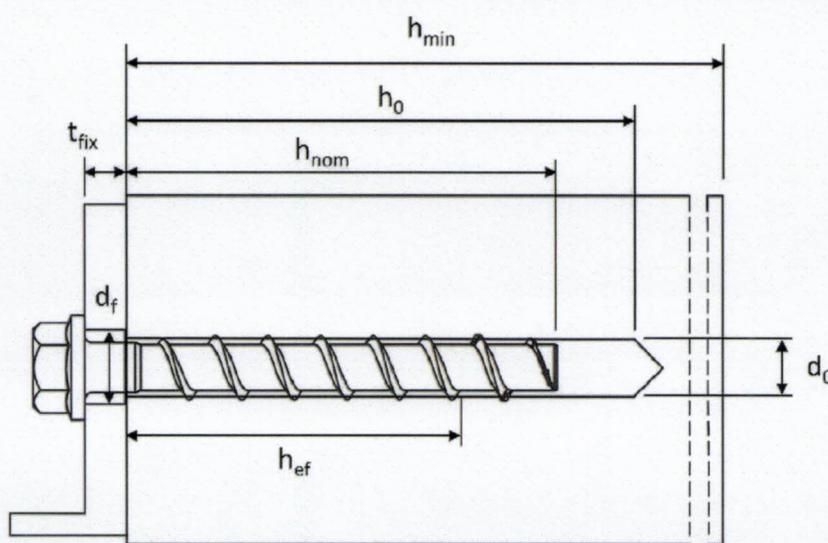


TOGE concrete screw TSM high Performance

Intended use
Installation parameters

Annex B3

Table 5: Minimum thickness of member, minimum edge distance and minimum spacing

TSM concrete screw size		6			8			10		
Nominal embedment depth	h_{nom}	$h_{\text{nom}1}$	$h_{\text{nom}2}$	$h_{\text{nom}1}$	$h_{\text{nom}2}$	$h_{\text{nom}3}$	$h_{\text{nom}1}$	$h_{\text{nom}2}$	$h_{\text{nom}3}$	
	[mm]	40	55	45	55	65	55	75	85	
Minimum thickness of member	h_{min}	h_{min} [mm]		100		100		120	100	130
Minimum edge distance	c_{min}	c_{min} [mm]		40		40		50	50	
Minimum spacing	s_{min}	s_{min} [mm]		40		50		50		
TSM concrete screw size		12				14				
Nominal embedment depth	h_{nom}	$h_{\text{nom}1}$	$h_{\text{nom}2}$	$h_{\text{nom}3}$	$h_{\text{nom}1}$	$h_{\text{nom}2}$	$h_{\text{nom}3}$			
	[mm]	65	85	100	75	100	115			
Minimum thickness of member	h_{min}	h_{min} [mm]	120	130	150	130	150	170		
Minimum edge distance	c_{min}	c_{min} [mm]	50		70	50	70			
Minimum spacing	s_{min}	s_{min} [mm]	50		70	50	70			

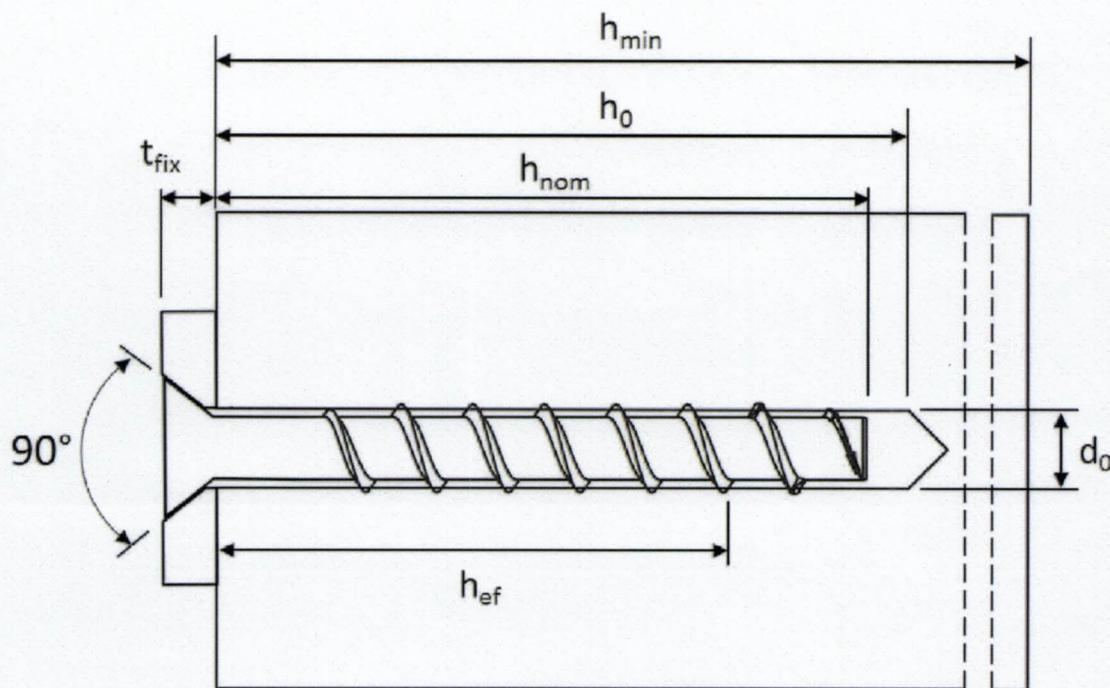


TOGE concrete screw TSM high Performance

Intended use


Minimum thickness of member, minimum edge distance and minimum spacing

Annex B4


Installation Instructions

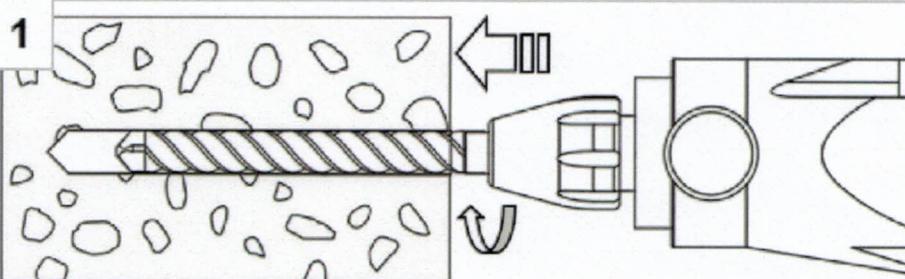


Create hammer drilled or hollow drilled borehole

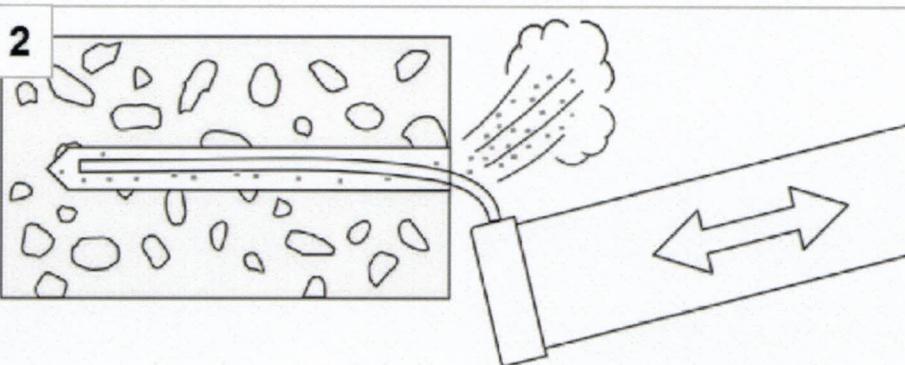

Remove drill dust by vacuuming or blowing off

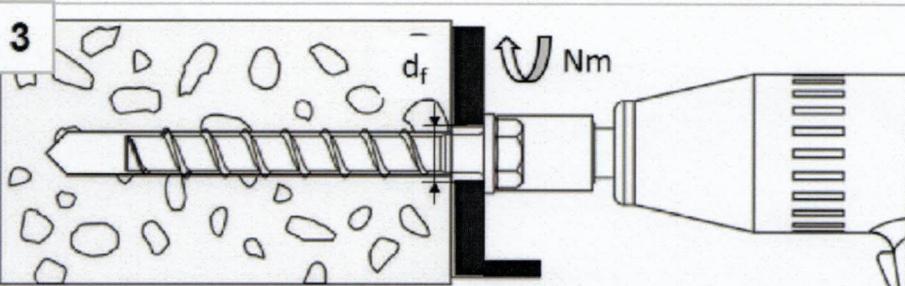

Install with torque
impact screw driver
or torque wrench

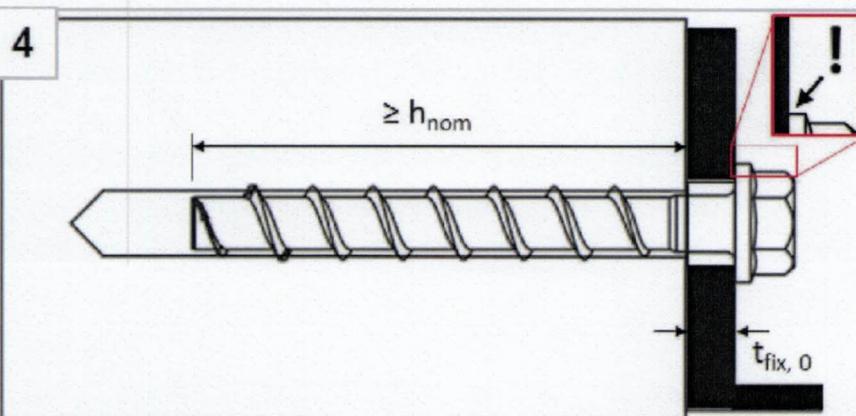

The head must be
undamaged and in
contact with the fixture

Note:

Cleaning of borehole is not necessary when using a hollow drill


TOGE concrete screw TSM high Performance

Intended use
Installation instructions

Annex B5


Installation Instructions – Adjustment

1. Adjustment

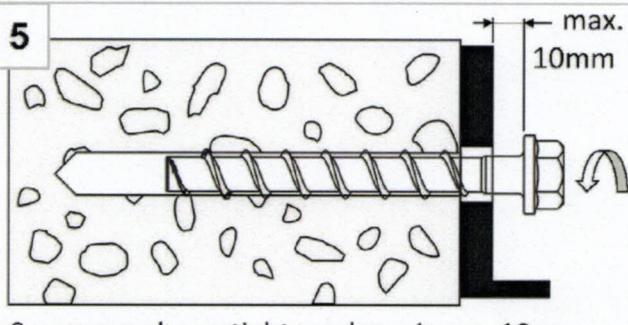


Screw may be untightened maximum 10mm


2. Adjustment

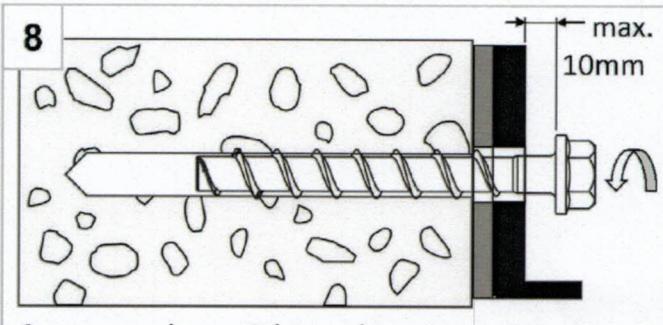


Screw may be untightened maximum 10mm

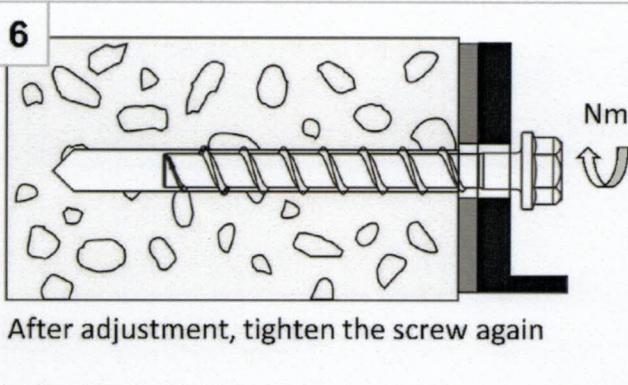


After adjustment, tighten the screw again

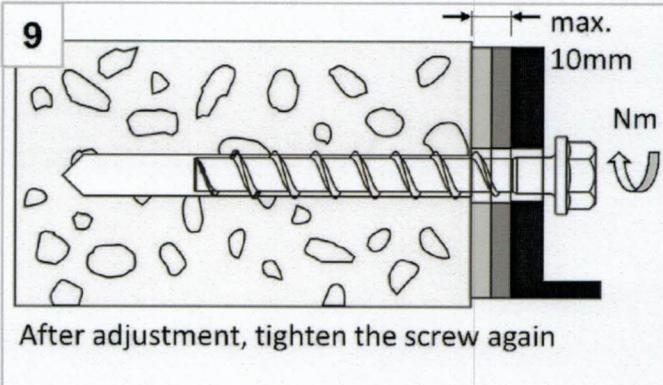

After adjustment, tighten the screw again

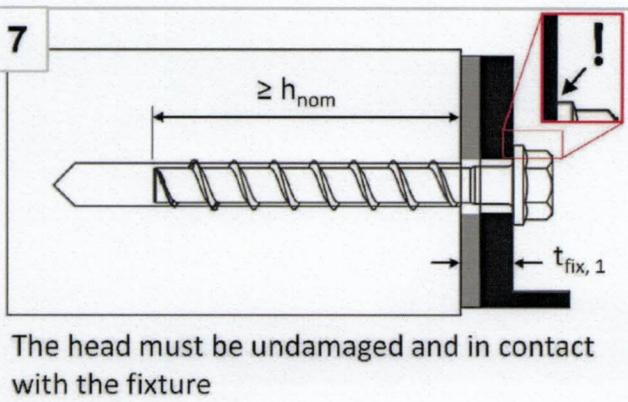

The head must be undamaged and in contact with the fixture

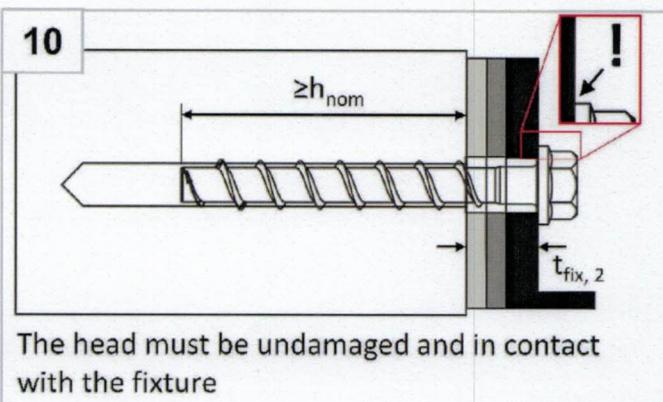

The head must be undamaged and in contact with the fixture

Note:

The fastener can be adjusted maximum two times. The total allowed thickness of shims added during the adjustment process is 10mm. The final embedment depth after adjustment process must be larger or equal than h_{nom} .

TOGE concrete screw TSM high Performance

Intended use
Installation instructions - Adjustment


Annex B6

Installation Instructions – Filling annular gap


Positioning of fixture and filling washer




After preparing borehole (Annex B5, figure 1+2), position first fixture (1), than filling washer (2)

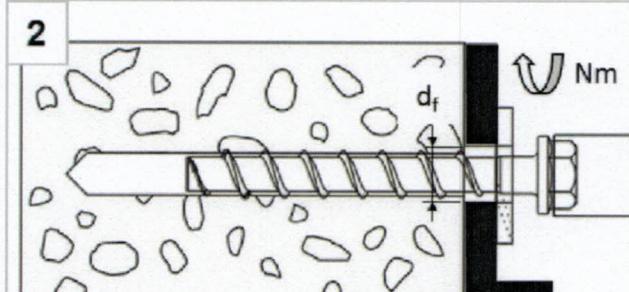

Install with torque impact screw driver
or torque wrench

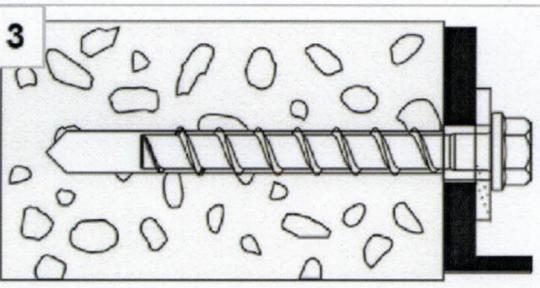


Installed condition without injected
mortar in the filling washer

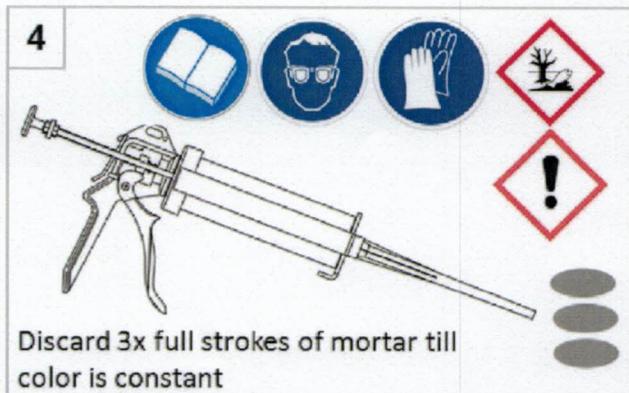

Discard 3x full strokes of mortar till
color is constant

Filling the annular gap

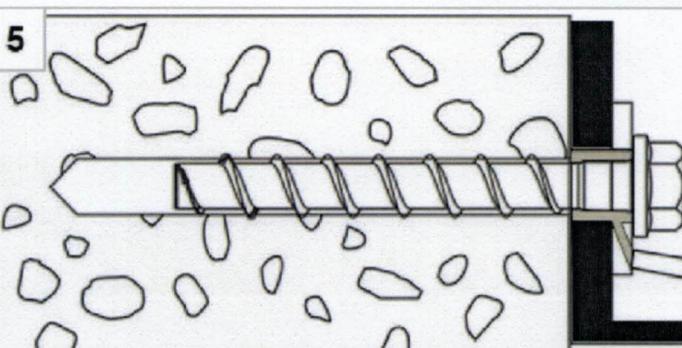

Fill the annular gap with injection mortar
(minimum compression strength of 40 N/mm²)

Note:

For seismic loading the installation with filled and without filled annular gap is approved.
Differences in performance can be found in Annex C5 - C7.

TOGE concrete screw TSM high Performance

Intended use

Installation instructions - Filling annular gap

Annex B7

Table 6: Characteristic values for static and quasi-static loading, sizes 6-10

TSM concrete screw size			6		8			10										
Nominal embedment depth	h_{nom}	$h_{\text{nom}1}$	$h_{\text{nom}2}$	$h_{\text{nom}1}$	$h_{\text{nom}2}$	$h_{\text{nom}3}$	$h_{\text{nom}1}$	$h_{\text{nom}2}$	$h_{\text{nom}3}$									
	[mm]	40	55	45	55	65	55	75	85									
Steel failure for tension and shear loading																		
Characteristic tension load	$N_{Rk,s}$	[kN]	14,0		27,0			45,0										
Partial factor	$\gamma_{Ms,N}$	[-]	1,5															
Characteristic shear load	$V^0_{Rk,s}$	[kN]	7,0		13,5		17,0	22,5	34,0									
Partial factor	$\gamma_{Ms,V}$	[-]	1,25															
Ductility factor	k_7	[-]	0,8															
Characteristic bending load	$M^0_{Rk,s}$	[Nm]	10,9		26,0			56,0										
Pull-out failure																		
Characteristic tension load C20/25	cracked	$N_{Rk,p}$	[kN]	2,0	4,0	5,0	9,0	12,0	9,0	$\geq N^0_{Rk,c}$ ¹⁾								
	uncracked	$N_{Rk,p}$	[kN]	4,0	9,0	7,5	12,0	16,0	12,0	20,0								
Increasing factor for $N_{Rk,p}$	C25/30	Ψ_c	[-]	1,12														
	C30/37			1,22														
	C40/50			1,41														
	C50/60			1,58														
Concrete failure: Splitting failure, concrete cone failure and pry-out failure																		
Effective embedment depth	h_{ef}	[mm]	31	44	35	43	52	43	60	68								
k-factor	cracked	k_{cr}	[-]	7,7														
	uncracked	k_{ucr}	[-]	11,0														
Concrete cone failure	spacing	$s_{cr,N}$	[mm]	3 x h_{ef}														
	edge distance	$c_{cr,N}$	[mm]	1,5 x h_{ef}														
Splitting failure	resistance	$N^0_{Rk,sp}$	[kN]	4,0	9,0	7,5	12,0	16,0	12,0	20,0								
	spacing	$s_{cr,sp}$	[mm]	120	160	120	140	150	140	180								
	edge distance	$c_{cr,sp}$	[mm]	60	80	60	70	75	70	90								
Factor for pry-out failure	k_8	[-]	1,0															
Installation factor	γ_{inst}	[-]	1,0															
Concrete edge failure																		
Effective length in concrete	$l_f = h_{\text{ef}}$	[mm]	31	44	35	43	52	43	60	68								
Nominal outer diameter of screw	d_{nom}	[mm]	6		8			10										
1) $N^0_{Rk,c}$ according to EN 1992-4:2018																		
TOGE concrete screw TSM high Performance																		
Performances Characteristic values for static and quasi-static loading, sizes 6-10								Annex C1										

Table 7: Characteristic values for static and quasi-static loading, sizes 12-14

TSM concrete screw size			12			14									
Nominal embedment depth	h_{nom} [mm]	$h_{\text{nom}1}$	$h_{\text{nom}2}$	$h_{\text{nom}3}$	$h_{\text{nom}1}$	$h_{\text{nom}2}$	$h_{\text{nom}3}$								
		65	85	100	75	100	115								
Steel failure for tension and shear loading															
Characteristic tension load	$N_{Rk,s}$	[kN]	67,0			94,0									
Partial factor	$\gamma_{Ms,N}$	[-]	1,5												
Characteristic shear load	$V^0_{Rk,s}$	[kN]	33,5	42,0		56,0									
Partial factor	$\gamma_{Ms,V}$	[-]	1,25												
Ductility factor	k_7	[-]	0,8												
Characteristic bending load	$M^0_{Rk,s}$	[Nm]	113,0			185,0									
Pull-out failure															
Characteristic tension load C20/25	cracked	$N_{Rk,p}$	[kN]	12,0	$\geq N^0_{Rk,c}$ ¹⁾										
	uncracked	$N_{Rk,p}$	[kN]	16,0											
Increasing factor for $N_{Rk,p}$	C25/30	Ψ_c	[-]	1,12											
	C30/37			1,22											
	C40/50			1,41											
	C50/60			1,58											
Concrete failure: Splitting failure, concrete cone failure and pry-out failure															
Effective embedment depth	h_{ef}	[mm]	50	67	80	58	79	92							
k-factor	cracked	$k_1 = k_{cr}$	[-]	7,7											
	uncracked	$k_1 = k_{ucr}$	[-]	11,0											
Concrete cone failure	spacing	$s_{cr,N}$	[mm]	3 x h_{ef}											
	edge distance	$c_{cr,N}$	[mm]	1,5 x h_{ef}											
Splitting failure	resistance	$N^0_{Rk,sp}$	[kN]	16,0	27,0	35,0	21,5	34,5							
	spacing	$s_{cr,Sp}$	[mm]	150	210	240	180	240							
	edge distance	$c_{cr,Sp}$	[mm]	75	105	120	90	120							
Factor for pry-out failure	k_8	[-]	1,0	2,0		1,0	2,0								
Installation factor	γ_{inst}	[-]	1,0												
Concrete edge failure															
Effective length in concrete	$l_f = h_{\text{ef}}$	[mm]	50	67	80	58	79	92							
Nominal outer diameter of screw	d_{nom}	[mm]	12			14									
TOGE concrete screw TSM high Performance															
Performances Characteristic values for static and quasi-static loading, sizes 12-14							Annex C2								

¹⁾ $N^0_{Rk,c}$ according to EN 1992-4:2018

Table 8: Seismic category C1 – Characteristic load values (type S, type SK, type ST, type ST-6¹⁾, type P and type I¹⁾)

TSM concrete screw size		6	8	10	12	14
Nominal embedment depth	h_{nom} [mm]	$h_{\text{nom}1}$ 40	$h_{\text{nom}2}$ 55	$h_{\text{nom}3}$ 65	$h_{\text{nom}1}$ 55	$h_{\text{nom}3}$ 85
					100	115

Steel failure for tension and shear load (version type S, type SK, type ST, type ST-6¹⁾, type P, type I¹⁾)

Characteristic load	$N_{Rk,s,eq}$	[kN]	14,0	27,0	45,0	67,0	94,0
Partial factor	$\gamma_{Ms,eq}$	[-]			1,5		
Characteristic load	$V_{Rk,s,eq}$	[kN]	4,7	5,5	8,5	13,5	15,3
Partial factor	$\gamma_{Ms,eq}$	[-]			1,25		
With filling of the annular gap ²⁾	α_{gap}	[-]			1,0		
Without filling of the annular gap ³⁾	α_{gap}	[-]			0,5		

Pull-out failure (version type S, type SK, type ST, type ST-6¹⁾, type P, type I¹⁾)

Characteristic tension load in cracked concrete C20/25	$N_{Rk,p,eq}$	[kN]	2,0	4,0	12,0	9,0	$\geq N_{Rk,c}^0$ ⁴⁾
--	---------------	------	-----	-----	------	-----	---------------------------------

Concrete cone failure (version type S, type SK, type ST, type ST-6¹⁾, type P, type I¹⁾)

Effective embedment depth	h_{ef}	[mm]	31	44	52	43	68	80	92
Edge distance	$c_{cr,N}$	[mm]					1,5 x h_{ef}		
Spacing	$s_{cr,N}$	[mm]					3 x h_{ef}		
Installation safety factor	γ_{inst}	[-]					1,0		

Concrete pry-out failure (version type S, type SK, type ST, type P)

Factor for pry-out failure	k_8	[-]	1,0		2,0
----------------------------	-------	-----	-----	--	-----

Concrete edge failure (version type S, type SK, type ST, type P)

Effective length in concrete	$l_f = h_{\text{ef}}$	[mm]	31	44	52	43	68	80	92
Nominal outer diameter of screw	d_{nom}	[mm]	6	6	8	10	10	12	14

¹⁾ only tension load

²⁾ With filling of the annular gap according to annex B7, figure 5

³⁾ Without filling of the annular gap according to annex B5

⁴⁾ $N_{Rk,c}^0$ according to EN 1992-4:2018

TOGE concrete screw TSM high Performance

Performances

Seismic category C1 – Characteristic load values

Annex C3

Table 9: Seismic category C2¹⁾ – Characteristic load values with filled annular gap according to annex B7, figure 5 (type S, type ST, type P)

TSM concrete screw size		8	10	12	14
Nominal embedment depth	h_{nom}	h_{nom3}			
	[mm]	65	85	100	115
Steel failure for tension and shear load (version type S, type ST, type P)					
Characteristic load	$N_{Rk,s,\text{eq}}$	[kN]	27,0	45,0	67,0
Partial factor	$\gamma_{Ms,\text{eq}}$	[-]	1,5		
Characteristic load	$V_{Rk,s,\text{eq}}$	[kN]	9,9	18,5	31,6
Partial factor	$\gamma_{Ms,\text{eq}}$	[-]	1,25		
With filling of the annular gap	α_{gap}	[-]	1,0		
Pull-out failure (version type S, type ST, type P)					
Characteristic load in cracked concrete	$N_{Rk,p,\text{eq}}$	[kN]	2,4	5,4	7,1
Concrete cone failure (version type S, type ST, type P)					
Effective embedment depth	h_{ef}	[mm]	52	68	80
Edge distance	$c_{\text{cr},N}$	[mm]	$1,5 \times h_{\text{ef}}$		
Spacing	$s_{\text{cr},N}$	[mm]	$3 \times h_{\text{ef}}$		
Installation safety factor	γ_{inst}	[-]	1,0		
Concrete pry-out failure (version type S, type ST, type P)					
Factor for pry-out failure	k_8	[-]	1,0	2,0	
Concrete edge failure (version type S, type ST, type P)					
Effective length in concrete	$l_f = h_{\text{ef}}$	[mm]	52	68	80
Nominal outer diameter of screw	d_{nom}	[mm]	8	10	12

1) A4 and HCR not suitable

TOGE concrete screw TSM high Performance

Performances

Seismic category C2 – Characteristic load values with filled annular gap

Annex C4

Table 10: Seismic category C2¹⁾ – Characteristic load values **without filled annular gap according to annex B5 (type S, type ST, type P)**

TSM concrete screw size		8	10	12	14
Nominal embedment depth	h_{nom}	h_{nom3}			
	[mm]	65	85	100	115
Steel failure for tension and shear load (version type S, type ST, type P)					
Characteristic load	$N_{Rk,s,\text{eq}}$	[kN]	27,0	45,0	67,0
Partial factor	$\gamma_{Ms,\text{eq}}$	[-]		1,5	
Characteristic load	$V_{Rk,s,\text{eq}}$	[kN]	10,3	21,9	24,4
Partial factor	$\gamma_{Ms,\text{eq}}$	[-]		1,25	
Without filling of the annular gap	α_{gap}	[-]		0,5	
Pull-out failure (version type S, type ST, type P)					
Characteristic load in cracked concrete	$N_{Rk,p,\text{eq}}$	[kN]	2,4	5,4	7,1
Steel failure for tension and shear load (version type SK)					
Characteristic load	$N_{Rk,s,\text{eq}}$	[kN]	27,0	45,0	no performance assessed
Partial factor	$\gamma_{Ms,\text{eq}}$	[-]		1,5	
Characteristic load	$V_{Rk,s,\text{eq}}$	[kN]	3,6	13,7	
Partial factor	$\gamma_{Ms,\text{eq}}$	[-]		1,25	
Without filling of the annular gap	α_{gap}	[-]		0,5	
Pull-out failure (version type SK)					
Characteristic load in cracked concrete	$N_{Rk,p,\text{eq}}$	[kN]	2,4	5,4	no performance assessed
Concrete cone failure (version type S, type SK, type ST, type P)					
Effective embedment depth	h_{ef}	[mm]	52	68	80
Edge distance	$c_{cr,N}$	[mm]		1,5 x h_{ef}	
Spacing	$s_{cr,N}$	[mm]		3 x h_{ef}	
Installation safety factor	γ_{inst}	[-]		1,0	
Concrete pry-out failure (version type S, type SK, type ST, type P)					
Factor for pry-out failure	k_8	[-]	1,0		2,0
Concrete edge failure (version type S, type SK, type ST, type P)					
Effective length in concrete	$l_f = h_{\text{ef}}$	[mm]	52	68	80
Nominal outer diameter of screw	d_{nom}	[mm]	8	10	12
					14

¹⁾ A4 and HCR not suitable

TOGE concrete screw TSM high Performance

Performances

Seismic category C2 – Characteristic load values without filled annular gap

Annex C5

Table 11: Fire exposure – characteristic values of resistance

TSM concrete screw size			6		8			10			12			14															
Nominal embedment depth		h_{nom}	1	2	1	2	3	1	2	3	1	2	3	1	2	3													
		[mm]	40	55	45	55	65	55	75	85	65	85	100	75	100	115													
Steel failure for tension and shear load																													
characteristic Resistance	R30	$N_{Rk,s,fi30}$	[kN]	0,9		2,4		4,4		7,3		10,3																	
	R60	$N_{Rk,s,fi60}$	[kN]	0,8		1,7		3,3		5,8		8,2																	
	R90	$N_{Rk,s,fi90}$	[kN]	0,6		1,1		2,3		4,2		5,9																	
	R120	$N_{Rk,s,fi120}$	[kN]	0,4		0,7		1,7		3,4		4,8																	
	R30	$V_{Rk,s,fi30}$	[kN]	0,9		2,4		4,4		7,3		10,3																	
	R60	$V_{Rk,s,fi60}$	[kN]	0,8		1,7		3,3		5,8		8,2																	
	R90	$V_{Rk,s,fi90}$	[kN]	0,6		1,1		2,3		4,2		5,9																	
	R120	$V_{Rk,s,fi120}$	[kN]	0,4		0,7		1,7		3,4		4,8																	
	R30	$M^0_{Rk,s,fi30}$	[Nm]	0,7		2,4		5,9		12,3		20,4																	
	R60	$M^0_{Rk,s,fi60}$	[Nm]	0,6		1,8		4,5		9,7		15,9																	
	R90	$M^0_{Rk,s,fi90}$	[Nm]	0,5		1,2		3,0		7,0		11,6																	
	R120	$M^0_{Rk,s,fi120}$	[Nm]	0,3		0,9		2,3		5,7		9,4																	
Pull-out failure																													
Characteristic Resistance	R30- R90	$N_{Rk,p,fi}$	[kN]	0,5	1,0	1,3	2,3	3,0	2,3	4,0	4,8	3,0	4,7	6,2	3,8	6,0	7,6												
	R120	$N_{Rk,p,fi}$	[kN]	0,4	0,8	1,0	1,8	2,4	1,8	3,2	3,9	2,4	3,8	4,9	3,0	4,8	6,1												
Concrete cone failure																													
Characteristic Resistance	R30- R90	$N^0_{Rk,c,fi}$	[kN]	0,9	2,2	1,2	2,1	3,4	2,1	4,8	6,6	3,0	6,3	9,9	4,4	9,6	14,0												
	R120	$N^0_{Rk,c,fi}$	[kN]	0,7	1,8	1,0	1,7	2,7	1,7	3,8	5,3	2,4	5,1	7,9	3,5	7,6	11,2												
Edge distance																													
R30 bis R120		$c_{cr,fi}$	[mm]	$2 \times h_{ef}$																									
In case of fire attack from more than one side, the minimum edge distance shall be $\geq 300\text{mm}$.																													
Spacing																													
R30 bis R120		$s_{cr,fi}$	[mm]	$4 \times h_{ef}$																									
Pry-out failure																													
R30 bis R120		k_8	[-]	1,0			2,0			1,0			2,0			2,0													
The anchorage depth has to be increased for wet concrete by at least 30 mm compared to the given value.																													

TOGE concrete screw TSM high Performance

Performances

Fire exposure – characteristic values of resistance

Annex C6

Table 12: Displacements under static and quasi-static tension load

TSM concrete screw size			6		8			10		
Nominal embedment depth			h_{nom}	$h_{\text{nom}1}$	$h_{\text{nom}2}$	$h_{\text{nom}1}$	$h_{\text{nom}2}$	$h_{\text{nom}3}$	$h_{\text{nom}1}$	$h_{\text{nom}2}$
			[mm]	40	55	45	55	65	55	75
Cracked concrete	tension load	N	[kN]	0,95	1,9	2,4	4,3	5,7	4,3	7,9
	displacement	$\delta_{\text{N}0}$	[mm]	0,3	0,6	0,6	0,7	0,8	0,6	0,5
		$\delta_{\text{N}\infty}$	[mm]	0,4	0,4	0,6	1,0	0,9	0,4	1,2
Uncracked concrete	tension load	N	[kN]	1,9	4,3	3,6	5,7	7,6	5,7	9,5
	displacement	$\delta_{\text{N}0}$	[mm]	0,4	0,6	0,7	0,9	0,5	0,7	1,1
		$\delta_{\text{N}\infty}$	[mm]	0,4	0,4	0,6	1,0	0,9	0,4	1,2
TSM concrete screw size			12				14			
Nominal embedment depth			h_{nom}	$h_{\text{nom}1}$	$h_{\text{nom}2}$	$h_{\text{nom}3}$	$h_{\text{nom}1}$	$h_{\text{nom}2}$	$h_{\text{nom}3}$	
			[mm]	65	85	100	75	100	115	
Cracked concrete	tension load	N	[kN]	5,7	9,4	12,3	7,6	12,0	15,1	
	displacement	$\delta_{\text{N}0}$	[mm]	0,9	0,5	1,0	0,5	0,8	0,7	
		$\delta_{\text{N}\infty}$	[mm]	1,0	1,2	1,2	0,9	1,2	1,0	
Uncracked concrete	tension load	N	[kN]	7,6	13,2	17,2	10,6	16,9	21,2	
	displacement	$\delta_{\text{N}0}$	[mm]	1,0	1,1	1,2	0,9	1,2	0,8	
		$\delta_{\text{N}\infty}$	[mm]	1,0	1,2	1,2	0,9	1,2	1,0	

Table 13: Displacements under static and quasi-static shear load

TSM concrete screw size			6		8			10		
Nominal embedment depth			h_{nom}	$h_{\text{nom}1}$	$h_{\text{nom}2}$	$h_{\text{nom}1}$	$h_{\text{nom}2}$	$h_{\text{nom}3}$	$h_{\text{nom}1}$	$h_{\text{nom}2}$
			[mm]	40	55	45	55	65	55	75
Cracked and uncracked concrete	shear load	V	[kN]	3,3		8,6			16,2	
	displacement	$\delta_{\text{v}0}$	[mm]	1,55		2,7			2,7	
		$\delta_{\text{v}\infty}$	[mm]	3,1		4,1			4,3	
TSM concrete screw size			12				14			
Nominal embedment depth			h_{nom}	$h_{\text{nom}1}$	$h_{\text{nom}2}$	$h_{\text{nom}3}$	$h_{\text{nom}1}$	$h_{\text{nom}2}$	$h_{\text{nom}3}$	
			[mm]	65	85	100	75	100	115	
Cracked and uncracked concrete	shear load	V	[kN]	20,0				30,5		
	displacement	$\delta_{\text{v}0}$	[mm]	4,0				3,1		
		$\delta_{\text{v}\infty}$	[mm]	6,0				4,7		

TOGE concrete screw TSM high Performance

Performances

Displacements under static and quasi-static loads

Annex C7

Table 14: Seismic category C2¹⁾ – Displacements **with filled annular gap according to annex B7, figure 5** (type S, type ST, type P)

TSM concrete screw size		8	10	12	14
Nominal embedment depth	h_{nom}	$h_{\text{nom}3}$			
	[mm]	65	85	100	115
Displacements under tension loads (version type S, type ST, type P)					
Displacement DLS	$\delta_{N,\text{eq}(DLS)}$	[mm]	0,66	0,32	0,57
Displacement ULS	$\delta_{N,\text{eq}(ULS)}$	[mm]	1,74	1,36	2,36
Displacements under shear loads (version type S, type ST, type P with hole clearance)					
Displacement DLS	$\delta_{V,\text{eq}(DLS)}$	[mm]	1,68	2,91	1,88
Displacement ULS	$\delta_{V,\text{eq}(ULS)}$	[mm]	5,19	6,72	5,37

Table 15: Seismic category C2¹⁾ – Displacements **without filled annular gap according to annex B5** (type S, type SK, type ST, type P)

TSM concrete screw size		8	10	12	14
Nominal embedment depth	h_{nom}	$h_{\text{nom}3}$			
	[mm]	65	85	100	115
Displacements under tension loads (version type S, type ST, type P)					
Displacement DLS	$\delta_{N,\text{eq}(DLS)}$	[mm]	0,66	0,32	0,57
Displacement ULS	$\delta_{N,\text{eq}(ULS)}$	[mm]	1,74	1,36	2,36
Displacements under tension loads (version type SK)					
Displacement DLS	$\delta_{N,\text{eq}(DLS)}$	[mm]	0,66	0,32	no performance assessed
Displacement ULS	$\delta_{N,\text{eq}(ULS)}$	[mm]	1,74	1,36	
Displacements under shear loads (version type S, type ST, type P with hole clearance)					
Displacement DLS	$\delta_{V,\text{eq}(DLS)}$	[mm]	4,21	4,71	4,42
Displacement ULS	$\delta_{V,\text{eq}(ULS)}$	[mm]	7,13	8,83	6,95
Displacements under shear loads (version type SK with hole clearance)					
Displacement DLS	$\delta_{V,\text{eq}(DLS)}$	[mm]	2,51	2,98	no performance assessed
Displacement ULS	$\delta_{V,\text{eq}(ULS)}$	[mm]	7,76	6,25	

¹⁾ A4 and HCR not suitable

TOGE concrete screw TSM high Performance

Performances

Displacements under seismic loads

Annex C8